

Operating functions



09

POWER GUIDE 2009 / BOOK 09

INTRO

Irrespective of the requirement for continuity of service, operation and maintenance work on installations must be carried out in maximum safety. They must be performed in accordance with strict protocols to ensure everyone's safety: those carrying out the work and others. This work requires special isolation, locking, separation (forms) and signalling devices, which are added to the basic breaking and protection functions.

Safety standards and regulations govern this field under the generic term "safety requirements". In addition, breaking devices for emergencies are generally required by specific texts: safety of workers, public buildings, etc. In modern installations, additional provisions and methods are necessary to meet the ever-increasing requirements for reliability, continuity of service, adaptability, safety and management of energy sources. Standard operational actions: switching on/off, changing power supply, measurements, resetting, are more and more often centralised or automated. For this, auxiliaries are used for remote control (coils, motor-driven controls, etc.) and for feeding back information on the status of devices.

Locking out structures and equipment

| | |
|--|----|
| Lockout operations | 03 |
| 1. Separation | 03 |
| 2. Immobilisation | 04 |
| 3. Dissipation (or setting to the lowest energy level) | 04 |
| 4. Checking | 04 |
| 5. Signalling | 04 |
| 6. Identification | 04 |
| Definitions (usual terms) | 05 |
| 1. Structures | 05 |
| 2. Operational actions | 05 |
| 3. Training and qualification | 07 |
| 4. Accreditations | 07 |
| 5. Authorisations | 08 |
| 6. Immobilisation | 08 |
| 7. Locking | 08 |
| Standard diagrams with locking procedures | 09 |
| Work on equipment | 12 |
| 1. Fixed devices | 12 |
| 2. Plug in devices | 12 |
| 3. Draw-out devices | 12 |
| 4. Busbars | 13 |

Physical accessibility and protection provisions

| | |
|--|----|
| Separation forms | 14 |
| 1. Form 1 | 15 |
| 2. Forms 2a and 2b | 15 |
| 3. Forms 3a and 3b | 16 |
| 4. Forms 4a and 4b | 17 |
| 5. Determining forms with XL PRO ² software | 18 |

Motorisation and supply inversion

| | |
|----------------------|----|
| Motor-driven control | 20 |
| Supply inverters | 21 |
| Control units | 22 |

Emergency breaking and stops, isolation

| | |
|--|----|
| Emergency breaking | 24 |
| The emergency stop | 28 |
| Isolation | 30 |
| 1. Isolation with permanent contact indication | 30 |
| 2. Isolation with visible contact indication | 31 |

Choice of products

| | |
|--|----|
| DMX ³ ACBs and DMX ³ -I trip-free switches | 32 |
| DMX-E air circuit breakers | 34 |
| DPX circuit breakers and DPX-I trip-free switches | 36 |
| DRX circuit breakers | 40 |
| DPX-IS and Vistop isolating switches | 41 |
| XL ³ 4000 forms | 42 |


Locking out structures and equipment

Isolation, switching, checking, testing and maintenance are all operations that must be carried out and planned with great care, in order to maintain the safety of people and property. To this end, a number of duly identified and organised actions are necessary. Together they constitute locking out.

To ensure continuity of operation and even safety, the lockout operations must as far as possible be restricted to limited parts of the installation. It is therefore necessary to have full knowledge of the entire operation of the installation before locking

out part of that installation. This applies to industrial processes, and also commercial installations (for example, data centers) especially when there are several power supplies.

Example of a power supply layout for a data centre

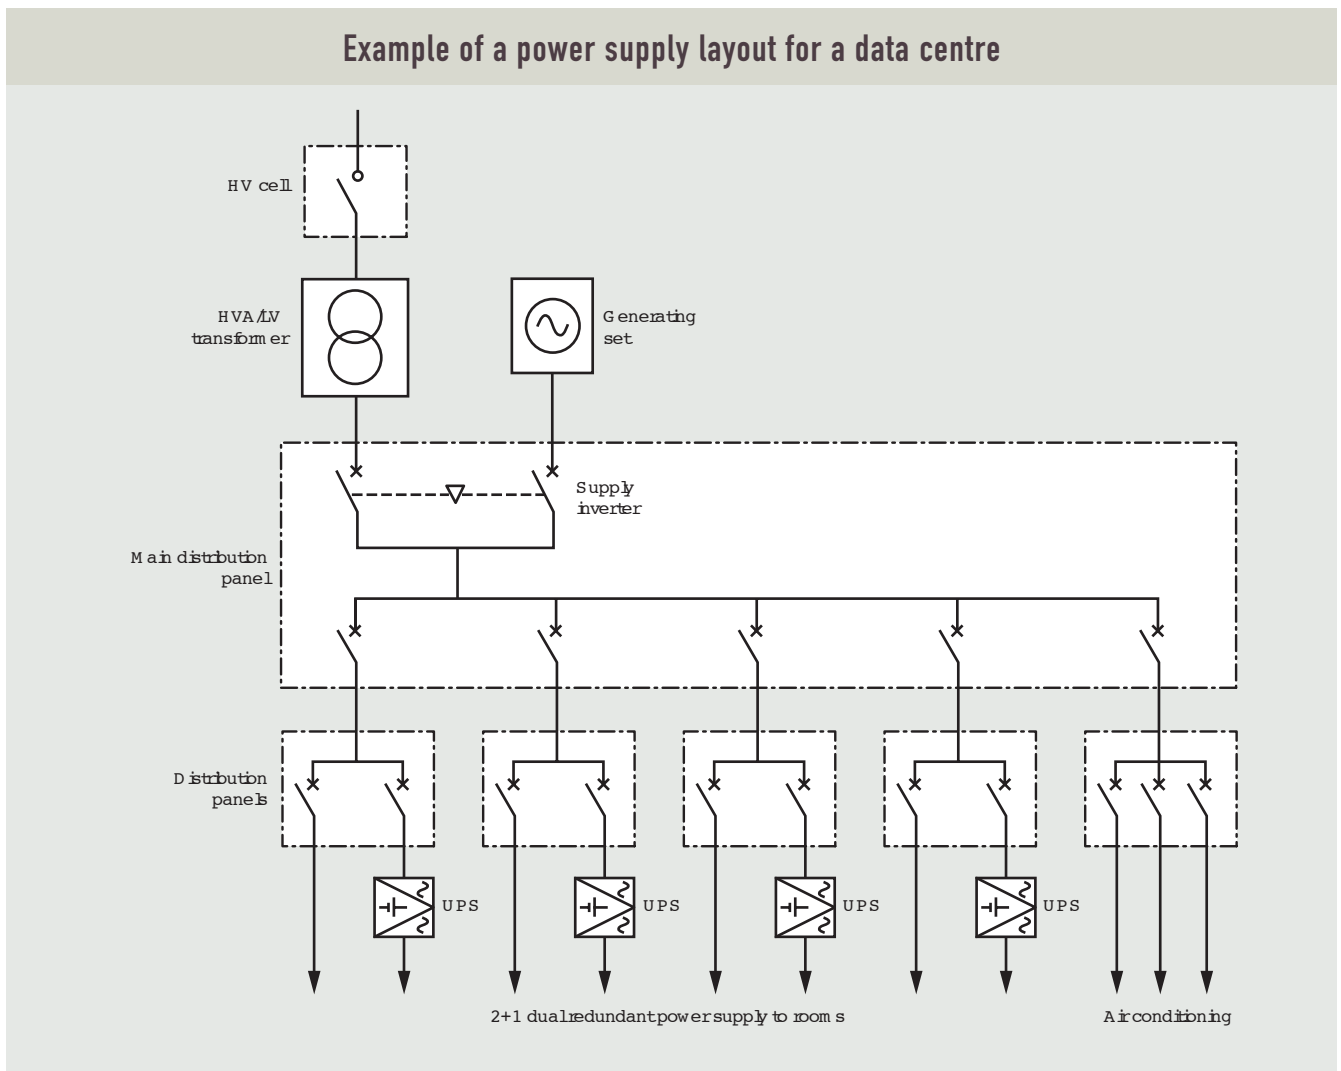

LOCKOUT OPERATIONS

The “lockout” or “safety procedure” is a precise, clearly-defined operation, the aim of which is always to ensure that situations are, and remain, safe. This will enable people to work on all or part of an installation (or a device), with return to operation (removal of lockout) only being possible by the intentional, concerted action of those responsible. Lockout consists of a number of essential steps:

separation, immobilisation, dissipation, checking, signalling and identification.

1 SEPARATION

This consists of “de-energising” all power, control and monitoring, and emergency circuits by breaking with visible or positive contact indication.

Head-end breaking

Head-end breaking can be carried out by an isolating switch or an isolating switch with visible contact indication (Vistop, DPX-IS) or by a device which has both adequate clearances and reliable control between the position of the contacts and that of the operating device (DPX).

This condition can be met by using a DPX or DMX type draw-out device or by combining an isolating switch with a DPX circuit breaker.

■ Positive contact indication



Positive contact indication ensures there is a permanent mechanical link between the contacts and the operating handle. The position of the operating handle indicates the actual position of the contacts. It cannot be set to OFF if the contacts are soldered

■ Visible contact indication



The Vistop and the DPX-IS provide isolation with visible contact indication. The operating handle can have up to 3 lockout padlocks

Locking out structures and equipment (continued)

2 IMMOBILISATION

This is carried out by mechanical means using padlocks or locks. It prevents any intentional or accidental operation of the immobilised device. It should be noted that profiled keys (triangle, square, etc.) are not permitted for this function.



^ Immobilisation of a DPX 630 with padlocking accessory and padlock

3 DISSIPATION (OR SETTING TO THE LOWEST ENERGY LEVEL)

This consists of discharging the capacitors. For maximum safety, it includes the earthing and short-circuiting of the conductors. It is compulsory above 500 V, but is not compulsory below this level (LV range) unless there is a risk of induced voltages, capacitive effects (capacitors or considerable lengths) or a risk of backfeed.

4 CHECKING

This must be carried out as close as possible to the location of the operation, with a standard device for "detecting the absence of voltage" (EN 61243-5) between all the conductors including the neutral and between those conductors and earth. Multimeter or tester type checking devices are expressly prohibited. These first four systematic steps must be accompanied by the means required for informing people "not working and working" on the equipment.

5 SIGNALLING

This consists of clear, precise and permanent information on the lockout status of the installation. It may be necessary to mark out the area.



It should be noted that in the LV range (< 500 V), it is possible to affix a sign prohibiting operation of the separation device in exceptional circumstances if the device has no means of immobilisation. This practice must not be permitted if the device cannot be seen from where it is operated.

6 IDENTIFICATION

This must enable targeted work, with no ambiguity, to be carried out on the device or part of the installation concerned. To this end, up to date wiring diagrams, geographical location maps, markings, etc., must be available.



DEFINITIONS (USUAL TERMS)

1 STRUCTURES

Although the general principles remain the same for all lockout operations, the measures to be taken may differ depending on the scope concerned: network, installations, devices and equipment.

1.1. Distribution networks

This concerns the part of the structures that is the responsibility of the energy distribution company. Rules (for example, EDF specifications), which are subject to specific decrees, are applicable to these networks.

1.2. Electrical installations

These consist of all the equipment involved in the transformation, transport, distribution and provision of energy.

The main LV distribution board is part of the installation.

Standard IEC 60364-1 establishes harmonised international rules for the design, setup and checking of electrical installations. These rules are designed to ensure the safety of people, animals and property with regard to the hazards and damage that may occur during reasonable use of electrical installations and to ensure correct operation of these installations. Standard IEC 60364-1 applies to the design, setup and checking of electrical installations such as those in: residential buildings, commercial buildings, public buildings, industrial establishments, agricultural and horticultural establishments, prefabricated buildings, caravans, campsites and similar installations, construction sites, funfairs, fairs, exhibitions and other temporary installations, marinas, external lighting and similar installations, medical premises, mobile or transportable units, photovoltaic systems, low voltage generating sets.

Numerous national standards or regulations are often added to these basic rules. In France, for example, these may include the decree of 14 November 1988

on the protection of workers in premises where electricity is used, the Safety Regulations for Public Buildings and various standards said to be for installations: NFC 13-100 (supply stations), NFC 13-200 (high voltage installations), NFC 14-100 (Connection installations), etc.

1.3. Devices and equipment

These consist of busbar systems and accessories. Secondary distribution boards and terminal boards containing controls and protection are included in devices and equipment. There are many applicable standards, specific to each item of equipment or family of devices: the EN 60439, EN 60204, EN 60947, etc. series of standards.

2 OPERATIONAL ACTIONS

Operational actions are intended for standard operations: switch on/off, connections for this purpose, measurements, resetting that can be carried out without any particular risk in the context of normal operation.



^ DMX³ 2500:
draw-out version

Locking out structures and equipment (continued)

These must not be confused with emergency operations, which arise from the need to provide optimum protection of people and property within the context of dangerous circumstances. Operational actions require basic safety precautions, taking care in particular to use personal protection devices (insulated gloves), measuring devices and appropriate test plugs, insulated pliers, etc.

The risk of short-circuits must be minimised in view of their consequences.

In principle, the steps must be taken after first carrying out an analysis which includes:

- The type of work (measurements, testing,

connection, cleaning, etc.)

- The general environmental conditions, in particular the atmospheric conditions (precipitation or risk of storms)

- The actual conditions of inaccessibility to unqualified people or possibility of contact with the earth potential

- The requirements specific to "live working" which are divided into: "insulated glove working", "safe clearance working" or "bare hand working". These are in all cases subject to specific accreditation granted by the head of the establishment. Carrying out live work is subject to the appropriate procedures and requires special protection equipment and tools.



Titles of those involved according to standards

Standard EN 50110-1 has laid the foundations of European harmonisation aimed at gradual alignment of the safety levels associated with the operation of, and work on or near installations. These minimum specifications can be supplemented by additional national requirements. In France, the collection of general electrical safety instructions UTE C 18-510 constitutes the main reference document in the field. Its presentation in the form of a booklet is aimed at making it a real everyday tool. The following definitions concerning people are taken from this book. Those marked (EN) are also used by standard EN 50110-1.

■ Employer

Person who, directly or indirectly, assumes legal responsibility in the context of the Labour Regulations. To avoid any confusion between the company which is the ordering customer and the company carrying out the work, the term head of the establishment or operator can be used for the former and company manager for the latter.

■ Operation supervisor (EN)

Person designated by the employer to carry out the operation of an electrical structure, including the performance of work and interventions.

■ Electrical lockout supervisor

Person designated by the employer or the operation supervisor to carry out all or part of the lockout and to ensure appropriate safety measures are taken.

■ Requisition supervisor

Person designated by the operation manager, responsible

for requisitioning all or part of structures, mainly networks or installations spread over wide areas. For the requisitioned part, he/she may then perform the role of lockout supervisor.

■ Works supervisor (EN)

Person who manages work. Responsible for taking, or ensuring others take, safety measures, and ensuring they are implemented. This person may work on his/her own, or be involved in the work he/she manages.

■ Test supervisor

Person who manages tests. He/she is responsible for taking the necessary measures and ensuring they are implemented.

■ Operative

Person designated by his/her employer to carry out work in accordance with a verbal or written instruction. He/she must have the appropriate qualification for the work to be performed.

■ Electrical safety supervisor

Safety specialist made responsible by his/her employer for monitoring the safety of people working on or in the vicinity of the electrical structures.

■ Qualified person (EN)

Person with the appropriate knowledge for carrying out the tasks assigned to him/her.

■ General foreman

Person carrying out on-site management of non-electrical work in the installation. If he/she carries out electrical work, he/she is called the works supervisor.

3 TRAINING AND QUALIFICATION

A special theoretical and practical training programme, representative of the work to be carried out, must be drawn up to develop and maintain the ability of qualified or well-informed people to carry out electrical work and in particular live work. At the end of the training, the participant must be awarded a certificate. The aptitude level is validated by accreditation which must be renewed if the person changes job or line manager, has a long break from work, medical restrictions, clear lack of aptitude, or if there are significant changes to work methods or installations.

4 ACCREDITATIONS

Accreditation consists of the recognition by the employer of a person's aptitude to perform the tasks assigned to him/her totally safely. A written certificate of accreditation, including the identification and approval of the parties and the code of the level of accreditation, must be given to the employee. This certificate does not however release the employer from his/her responsibilities. The accreditation level must be appropriate to the work to be carried out: it will be different for example for the painter who is working in a transformer room and the electrician working on the transformer itself. But it is essential that they have both received training appropriate to the risks incurred to themselves and to others.

Accreditation code

UTE guide C 18-510 defines a code that is widely used in France and several European countries

- **First letter:**
 - B for the LV or ELV range
 - H for the HV range
- **Second letter (optional):**
 - R for repair, connection, testing or measurement work (LV only)
 - C for the ability to perform lockouts
 - T for live working
 - N for carrying out cleaning work while live
 - V for working in the vicinity of live parts
- **Number:**
 - 0 for staff not carrying out electrical work
 - 1 for staff carrying out electrical work
 - 2 for electrical works supervisor who can manage several people
- **Some (non-limiting) examples of common accreditations in the LV range:**
 - B0: Non-electrician who can access reserved areas
 - B1: Electrician working under instruction
 - BR: Works supervisor managing work he/she carries out and its safety
 - BC: Person responsible for the lockout.

!

Accreditation is obviously necessary for carrying out electrical work, but it is also required for managing this work, for monitoring, for locking out an installation, for carrying out tests and taking measurements, and of course simply for unsupervised access to an area reserved for electricians. For example, the person who carries out the cleaning on a test platform must be accredited accordingly.

Locking out structures and equipment (continued)

5 AUTHORISATIONS

Whatever work is undertaken, the lockout operation itself must form the subject of written documents and above all confirmation that these documents have been safely received by the addressee. Messages sent electronically (faxes, emails) must be subject to appropriate precautions regarding the guarantee of receipt and their being understood. A reply message with the identification number of the original message is compulsory. The read receipt is not sufficient. The lockout certificate will be used for this purpose. It must be sent to the works supervisor, marked with the date and time, and must incorporate a section for notification of the end of work. Other documents may be used. The list given here is not exhaustive: work order, operation sheet, instruction, notice of requisition, certificate of separation from the public distribution network, etc. For further details, please refer to the statutory texts currently in force.

6 IMMOBILISATION

The purpose of immobilisation is to prevent the operation of the separation device. It must include the mechanical immobilisation of the device and the disabling of all controls, whether these are electrical, electronic, radio, etc. In addition an indication (display, indicator, etc.) must clearly signal the immobilised state.



^ Draw-out DPX 630 immobilised using padlocks



< Adaptable locking unit on draw-out DPX 630

7 LOCKING

Only locking can ensure the immobilised state. Several locks are often used together:

- To order the sequence of operations (order of commands)
- To make the operations interdependent and alternative (for example, supply inversion)
- To necessitate the simultaneous action of several people (increased safety).

Locking is carried out taking into account the safety of people and property, for example: prevention of access to HV cells before they are de-energised, prevention of the opening or closing of an isolating switch which is on-load, etc.

When the key is released by the first lock and thus allows a second lock to be operated, this is referred to as interlocking with key transfer.

The locking sequence may also require the release of several keys: in this case a device with multiple locks enables the first key, referred to as the "mother key", which must remain captive, to release several keys, referred to as daughter keys.



The basic locking principle is based on the uniqueness of the key. One key may operate one or more locks, but it must never be possible for one lock to be operated by two identical keys.

STANDARD DIAGRAMS WITH LOCKING PROCEDURES

In all cases the choice of locks and safety positions requires prior analysis of the locking sequence to be applied in order to correctly define the requirement and clearly identify the related risks. "Electric" locking systems are never considered to be adequate. In principle, only "mechanical" locking systems are capable of ensuring safety (as long as they themselves are reliable). There are various possible graphic representations of locking mechanisms. Some representations give the status of the lock (bolt pushed in or not pushed in) and the key (not captive or captive). Diagrammatic symbols are also used, but it is advisable to explain complex sequences in words.

| Example of diagrammatic symbols (source APAVE-France) | |
|--|--|
| Lock mechanism assembly | |
| Lock with key never captive | |
| Lock with key always captive | |
| Lock with key captive device closed | |
| Lock with key captive device open | |


| Functional symbols | | | |
|---|--|--|--|
| Mechanical locking | | Keys head-to-tail | |
| Lock mechanism assembly | | Key not in lock/bolt pushed in free operation | |
| Key captive | | Key not in lock/bolt not pushed in operation blocked | |
| Key not in lock | | Key not captive/bolt pushed in free operation | |
| Key not captive | | Key not captive/bolt not pushed in operation blocked | |
| Key operation - insertion - extraction | | Key captive/bolt pushed in free operation | |
| Lock on door | | Key captive/bolt not pushed in operation blocked | |

Locking out structures and equipment (continued)

Example 1: Locking between earthing switch, HV switch and cell door

Locking sequence:

- Opening of switch I
- The key is released
- Transfer of key A to isolating switch S
- Closing of isolating switch S
- Key B is released
- Opening of the cell door with key B
- Key B remains captive

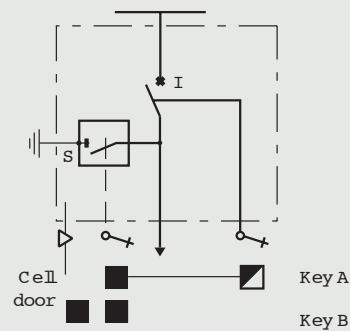

Example 2: Locking cells on HV loop system


The purpose of this procedure is to prevent the earthing switches closing when the cell is supplied upstream or downstream (loop-back).

Installation:

NB: switches I and isolating switches T are designed to be mechanically controlled.


Immobilisation sequence:

- Opening of switch I₁
- Immobilisation of switch I₁ and release of key A
- Opening of switch I₂
- Immobilisation of switch I₂ and release of key B
- Unlocking of earthing switch T₂ with key A
- Closing of earthing switch T₂
- Key A is captive
- Unlocking of earthing switch T₁ with key B
- Closing of earthing switch T₁
- Key B is captive

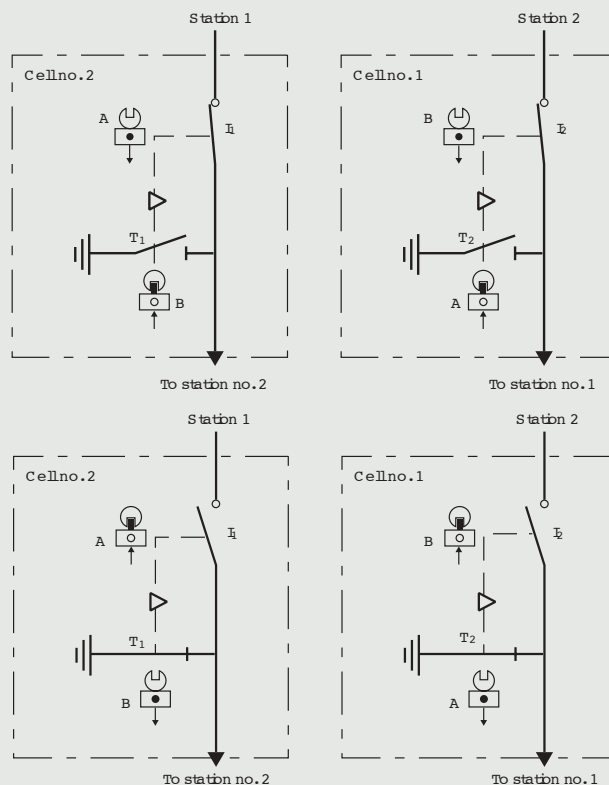

Example 3: Locking on supply inversion and on HV station

The draw-out circuit breaker is fitted with two locks.
 In normal operation, the circuit breaker I is closed, and keys A and B are captive.
 Opening the circuit breaker releases keys A and B. Key A is transferred to the HV cell upstream (see example 2).
 Key B is transferred to the standby supply (see example 4).
 Locking between the standby supply (circuit breaker G) and the HV cell may also be specified (second lock).



Example 4: HV/TR/LV locking (functional symbols)

Used in supply stations with LV metering, this sequence, which is one of the most common, is used to access the terminals of the transformer after:




- Opening and locking of the LV circuit breaker
- Opening and locking of the HV cell
- Earthing of the separate HV supply

Service state:

- The LV circuit breaker is closed
- Key O is captive
- The HV cell is closed
- Key S is captive
- The transformer terminals are not accessible

Locking sequence:

- Opening and drawing out of the LV circuit breaker
- Key O is released
- Transfer of key O to the lock on the HV cell
- Opening of the HV switch and closing of the earthing switch by mechanical control. Operation is possible by key transfer, as in example 1
- Key O becomes captive
- The cell panel can be opened
- Key S can be removed
- Unlocking of the immobilisation cover of the plug-in terminals
- Key S becomes captive

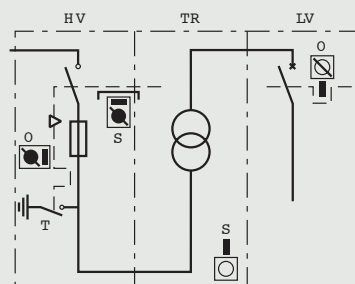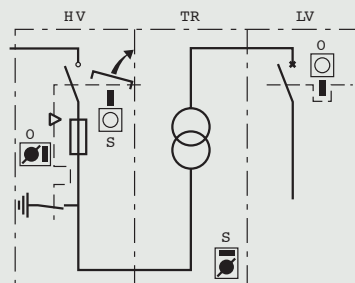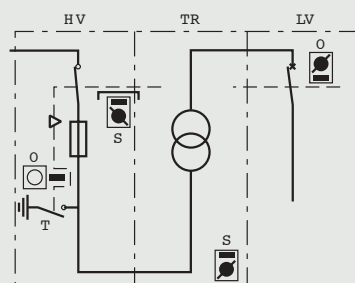

Locking out structures and equipment (continued)


Example 5: Locking on LV supply inversion

A standby power supply must only be coupled on an installation when it is certain that the main power supply is disconnected. Likewise, when devices cannot be installed side by side (supply inverter plate with integrated interlocking mechanism) or they are different types (for example, lower protected power), interlocking by key must be provided.

In normal operation: supply via transformer. Circuit breaker I is closed. Key A is captive.

In standby operation: circuit breaker I is open. The associated lock is unlocked and key A is released.

Key A is transferred to the lock on circuit breaker G, which is closed. Key A is captive.

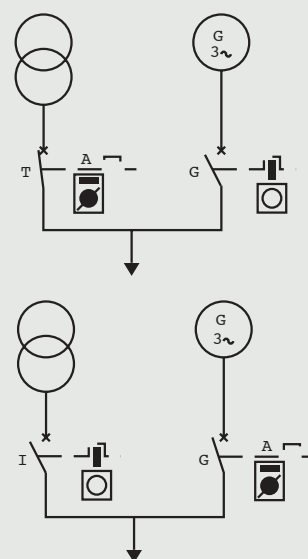

WORK ON EQUIPMENT

Power circuit breakers (devices designed to provide breaking and protection) are generally referred to using three terms: fixed, plug-in and draw-out.

1 FIXED DEVICES

Their connections can only be made or broken when their power supply is off (for example, connections on terminals or connectors). In general, it takes a certain time to fit and remove them and require a minimum number of tools. These devices are designated by the letter F ("Fixed parts"). They require an appropriate lockout upstream.

2 PLUG IN DEVICES

Plug-in (or disconnectable) devices can be inserted or removed without powering down the relevant circuit. Connection and disconnection are only possible when the device is open. Otherwise, disconnection causes mechanical breaking of the device.

Plug-in devices can, in simple situations, be used for isolation and making safe, but they are primarily used for their interchangeability, which makes maintenance much easier. They are designated by the letter D ("Disconnectable parts").

In general they do not require locking out of the installation.

3 DRAW-OUT DEVICES

In addition to the advantages of plug-in devices (interchangeability and isolation with visible contact indication), draw-out devices can be used, due to an associated mechanism, to control connection and disconnection, to enable testing and measurements while maintaining the continuity of the auxiliary circuits and breaking the main circuits, to display the status of these circuits, and by means of various systems (padlocks, locks, etc.) to lock the device for lockout operations.

Draw-out devices can be designated by the letter W ("Withdrawable parts").

Plug-in or draw-out DPX and draw-out DMX³ allow safe (IP 2x) and separate work on each circuit. DPX pre-equipped bases can take devices at a later date in the context of a scheduled extension.

As long as the device is not open, a safety system prevents any removal of the faceplate.

4 BUSBARS

Work on busbars almost always requires the upstream locking out of their power supply.

The use of a minimum separation form (form 2) provides protection against accidental contact if working in the vicinity.

Forms 3 and 4 combined with plug-in or draw-out devices provide solutions that allow individual safe access to the various outgoing lines, without the need for total lockout of the installation.

States of the circuits for different positions of draw-out DPX

| Circuits | Connected position | Test position | Isolation position | Drawn out position |
|-----------|--------------------|---------------|--------------------|--------------------|
| Main | | ⌋ | ○ | ○ |
| Auxiliary | | | ○ | ○ |

Connected: | Open: ⌋ Isolated: ○



< DPX 250 plug-in version, mounted on its base with rear terminals

DPX 1600 > draw-out



Physical accessibility and protection provisions

The main objective is to maintain the availability of the power supply while allowing safe working (protection index xxB) and limiting the effects of any internal fault in the panel (arcs, electrodynamic forces, disconnection, etc.)

SEPARATION FORMS

Forms are used to provide a gradual, appropriate response to the accessibility and protection of the main components of a power distribution panel: busbars and breaking and protection devices (functional units).

The type of form chosen will be determined according to the qualification of those involved, the protection required and the required level of maintainability. The use of forms enables the panel to be divided into closed protected spaces in order to achieve four objectives:

- Protection against direct contact with dangerous parts of neighbouring functional units (the degree of protection must be at least IP xxB).

- Protection against the entry of solid objects. The degree of protection must be at least IP2x (degree IP 2x covers IP xxB). These two requirements assume that the assembly is equipped with faceplates.

- Limitation of the effects of the spread of electric arcs.

- Facilitation of panel maintenance operations.

Standard EN 60439-1 defines the internal separation of assemblies into 7 types of form (1, 2a, 2b, 3a, 3b, 4a and 4b).

This internal separation is achieved in XL³ 4000 enclosures using barriers or screens made of metal or insulating material.

XL³ 4000 enclosures and their accessories can be used to create all types of form.




Separation used to create forms limits the natural ventilation of the panel and can therefore result in rises in temperature. It will inevitably increase the size and cost of the panel, both in terms of labour and components.



< Form 4b in the process of being set up in an XL³ enclosure

Form levels

As a general rule conformity with a higher level of form involves conformity with the lower levels of form, except for levels 3a, 2b and 2a.

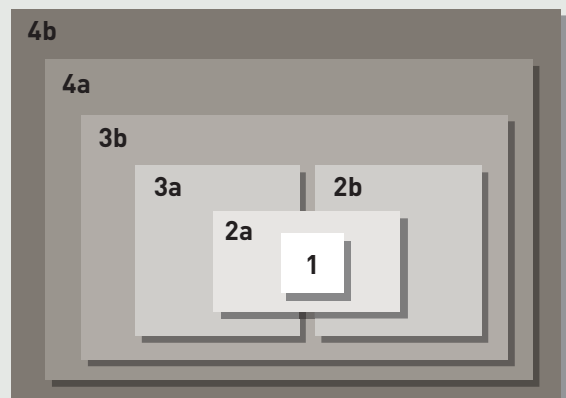

1 FORM 1


Form 1 does not require any separation between the components inside the enclosure.

2 FORMS 2a AND 2b


Form 2a is the simplest for protecting against accidental contact with the busbars, which are considered to be the most dangerous components. Form 2b includes additional separation to make it safe to work on outgoing lines.

Requirements of standards and creation in XL³ enclosures

■ Form 2a

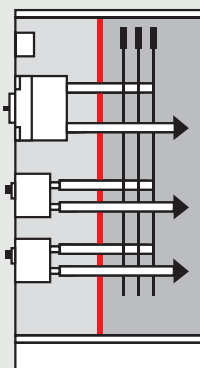


Separation of busbars from functional units.
Terminals for external conductors do not need to be separated from busbars.

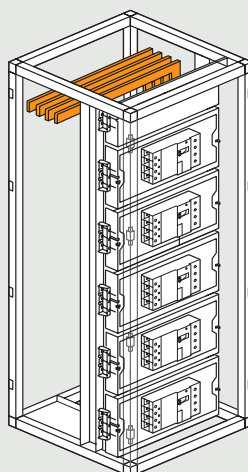


In XL³, the separation with the busbars is provided directly by the fixing plates. The devices are connected on rear terminals

■ Form 2b

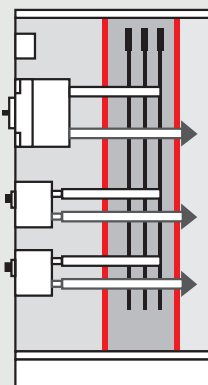

Separation of busbars from functional units.
Terminals for external conductors are separated from busbars.

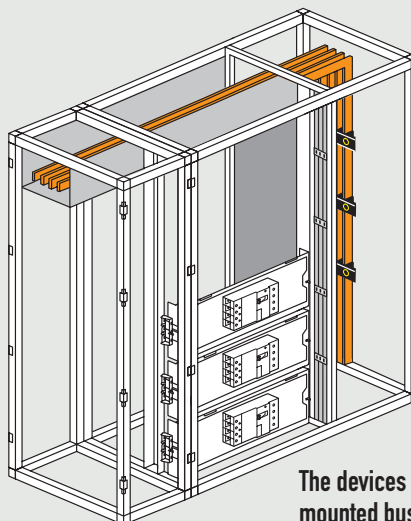

The devices are connected on the side-mounted busbar, on front terminals, through a vertical separation between the enclosure and the cable sleeve


Physical accessibility and protection provisions (continued)

3 FORMS 3a AND 3b

In form 3a, each device is isolated in a compartment which protects it from the effects of incidents which may occur on another device. Form 3b combines the advantages of form 3a and form 2b, separating the output terminals and the busbars.


Requirements of standards and creation in XL³ enclosures

■ Form 3a

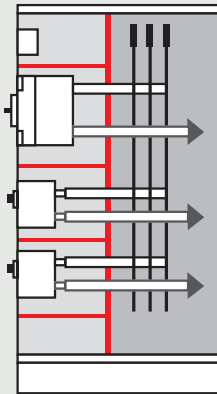


Separation of busbars from functional units and separation of all functional units from each other.

Terminals for external conductors are not separated from busbars.

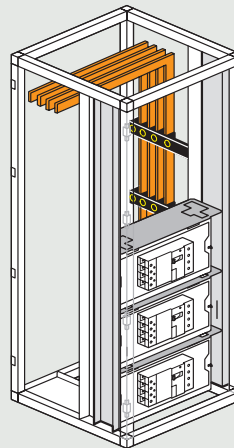


Form 3a is constructed based on form 2a with the addition of horizontal separations between the devices and vertical separations between the enclosures

■ Form 3b

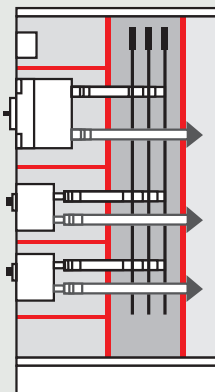

Separation of busbars from functional units and separation of all functional units from each other.

Terminals for external conductors are separated from busbars.

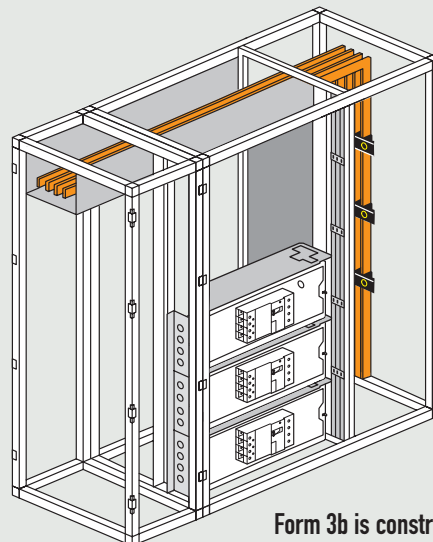


Form 3b is constructed based on form 2b with the addition of horizontal separations between the devices

4 FORMS 4a AND 4b


The requirements of form level 4a further increase the safety of working on outgoing lines by isolating the output terminals in the same compartment as the device. Form 4b provides maximum safety by separating all the functions from one another.

Requirements of standards and creation in XL³ enclosures

■ Form 4a

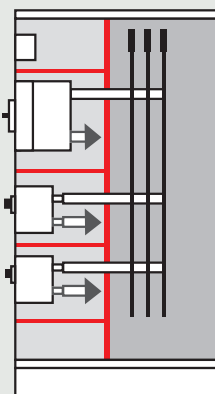


Separation of busbars from functional units and separation of all functional units from each other including the terminals for external conductors which are an integral part of the functional unit. Terminals for external conductors are in the same compartment as the functional unit.

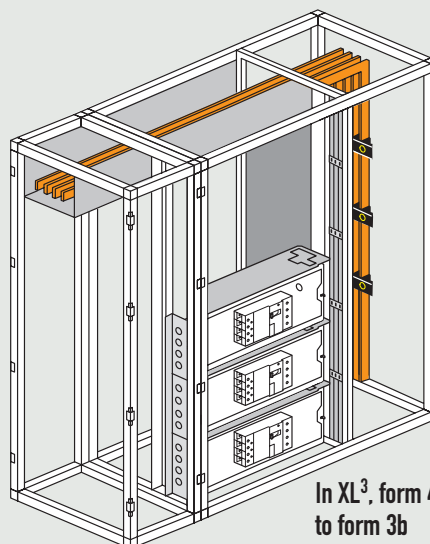


In XL³, form 4a is identical to form 3b

■ Form 4b

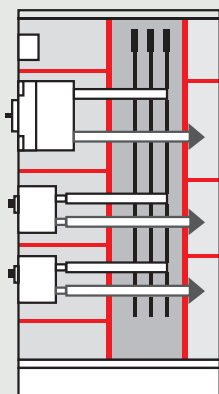

Separation of busbars from functional units and separation of all the functional units from each other including terminals for external conductors. Terminals for external conductors are not in the same compartment as the functional unit but in separate individual compartments.

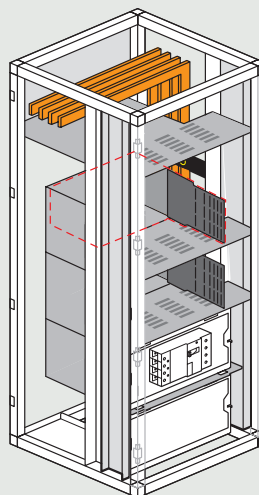

Each device is enclosed in a compartment. These compartments are stacked on top of each other and thus create the separation for the branch busbar

Physical accessibility and protection provisions (continued)


5 DETERMINING FORMS WITH XL PRO² SOFTWARE

5.1. Input data

To produce a design that includes forms, two mandatory pieces of information must be entered:

- The choice of product (DPX – DMX³ – DX)
- The associated busbar

A busbar can be associated with the main device either in the “Nomenclature” module (Cabling products > Associated busbars and distribution blocks) or in the “Arrangement” module (right-click on the circuit breaker, select “Associate with this product” and then “Associated busbars”).

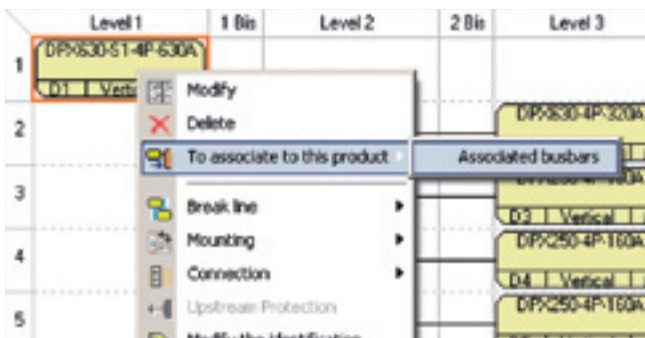


The busbar must be “top horizontal” or “side vertical” as these are the only distribution arrangements that can be partitioned in forms. If the assembly consists of more than two enclosures, the vertical busbars will be automatically connected using a top horizontal busbar. The horizontal busbar can be removed later if necessary.

XL-Pro² automatically creates branch busbars and the cable sleeves used to mount them.

5.2. Arrangement

Irrespective of the level of form required, the reference position for DPX is horizontal mounting.


In the “Arrangement” window, select all the devices then right-click to select “Mounting” then “Horizontal” (or click directly on the icon ). All the devices selected will be transformed into horizontal mounting position (if this was not already the case).

If the DPX are not positioned horizontally, XL-Pro² will do this automatically when the type of form is chosen, except in the case of supply inverters.




For horizontally mounted supply inverters, select the inverter in the “Arrangement” window and right-click to select “Inverter mounting” and then “Horizontal”.

Depending on the installation of the panel, select whether devices will be connected via front terminals or rear terminals.


In the “Arrangement” window, select all the devices then right-click to select “Connection” then “Front Terminals” or “Rear Terminals” (or click directly on the icon ).

All the devices selected will be transformed into front terminal or rear terminal connection depending on the choice made.

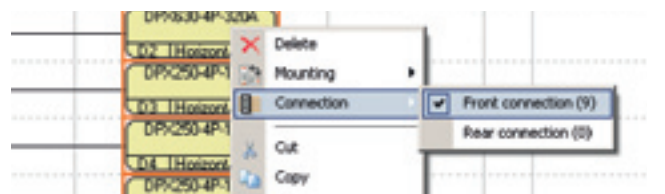


5.3. Selecting the enclosures

Products are selected in the same way as for a standard design.
 In the "Enclosures" window click on the "Forms..." button. If the panel does not have any associated busbars, XL-Pro² suggests adding one.

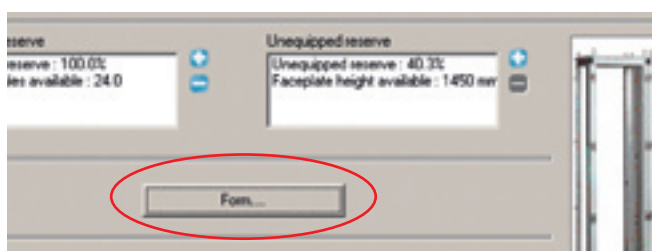


A window divided into 3 sections opens, for selecting:

1. The level of form required
2. The type of connection (front terminal or rear terminal)
3. The circuit diagram (power supply from the right, left or a "head-to-tail" power supply)

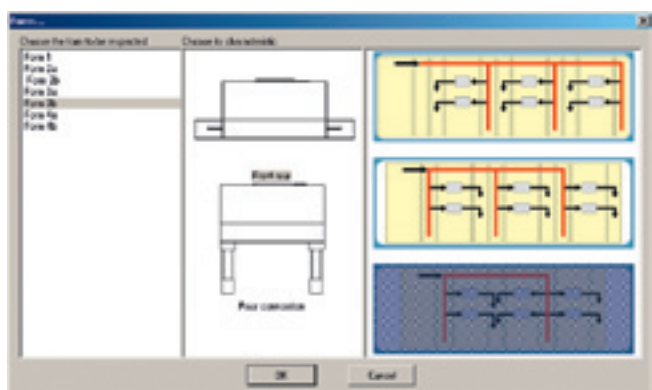

5.4. Preview

Once this information has been entered, XL-Pro² recalculates which enclosures are compatible. If the message "No family accepts the products selected" appears, this means that a product is incompatible with the enclosure configurations used to create the level of form required.
 Example: technical impossibility of mounting a DPX-IS horizontally as mounting plates are only available for mounting in a vertical position. For these specific cases concerning DPX-IS, it is advisable to use special plates and faceplates for vertical mounting, with connection on the front terminals, and to partition the space between the mounting plates using adjustable solid plates.

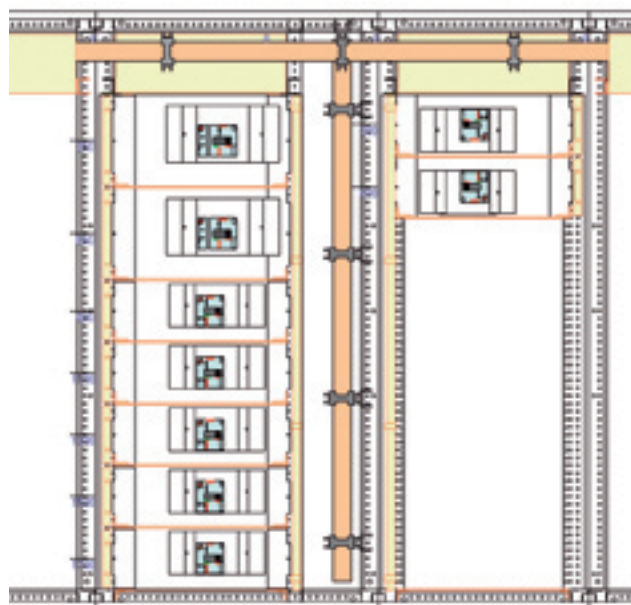

The "head-to-tail" circuit diagram is used to limit the number of branch busbars (and therefore the amount of copper used) but it requires alternate mounting of circuit breakers in the same enclosure assembly. In this case, the direction of opening must be clearly marked in order to ensure there is no ambiguity.

Motorisation and supply inversion

Motor-driven control can be used both in automated processes and safety processes (priority of service, breaking for fire, etc.). They enable remote control of supply circuits and load circuits in the context of building management. Automatic supply inversion is one of the main applications of motor-driven control.

MOTOR-DRIVEN CONTROL


Motor-driven controls enable remote control of the operation of the remote devices (on, off, reset). They are associated with appropriate electrical control layouts according to requirements.

In direct control layouts, operation is not instant and the changes of state take a few seconds. They are used more in control sequences in which this time is taken into account.

It is not advisable to use them for “emergency breaking” and their use must be prohibited for “emergency stops”.

Examples of layouts for these emergency functions are given on pages 27 and 29.

Layouts with control auxiliaries can be used in all situations. They enable multiple operations and pulse control, incorporating notions of positive safety (undervoltage releases).

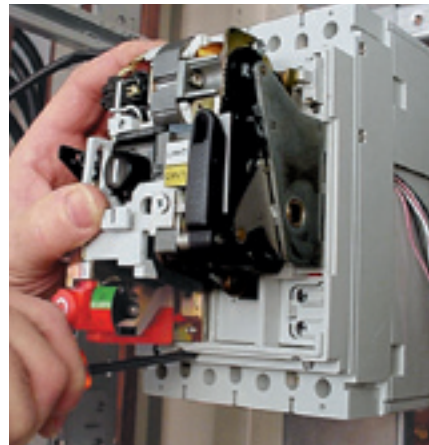


^ The motor-driven controls for DPX can be installed in the factory or directly on-site on wired devices



^ Motor-driven controls for DMX³



^ Motor-driven controls for DPX



^ Motor-driven controls for DX

SUPPLY INVERTERS

Supply inversion meets the dual requirement of continuity of service and increased safety. Historically used in hospitals, public buildings, continuous production processes, airport and military applications, there is now increasing demand for supply inversion in telecommunications and data processing applications and also in the management of “renewable” energy sources.

Supply inversion performs the following functions:

- Switching from a main (or normal) supply to a standby (backup) supply in order to supply circuits that require continuity of service
- Switching from a main supply to a standby supply

(2nd supply) for managing energy sources (energy saving by using sources other than the network, which may be linked to a load-shedding function)
 - Management of the operation of the safety supply for supplying safety circuits.



The supply inversion control system must not be confused with an uninterruptible power supply (UPS).



The supply inversion device ensures continuity of operation by switching over to a standby supply if there is a fault on the main supply. This supply inversion is carried out totally safely due to the mechanical and electrical interlocking devices.

It can be classified into three categories, depending on the degree of automation of the function.

- **Manual:** The simultaneous closing of both devices is prohibited by a mechanical interlock device integrated in the devices' support plate. It is only possible to close one device if the other device is open.
- **Remote control:** The devices are equipped with “motor-driven controls”. The closing and opening operations are therefore carried out remotely. The electrical layout and the control system must be created on a case by case basis depending on the requirements.
- **Automatic:** A control unit manages the inversion. The switchover to the standby supply is carried out automatically if there is a fault on the main supply, and vice versa after the restoration of this supply.



< Assembly with DMX³ supply inverter

Motorisation and supply inversion (continued)

Legrand supply inverters are available in three categories (manual, remote control and automatic) with DPX 160, 250 ER, 250, 630, 1600, DMX³ 2500, 4000 and DMX-E devices in fixed and draw-out circuit breaker or switch versions.

Like motor-driven controls, supply inversion can be carried out in accordance with two control principles:

- One, without coils, which enables simplified wiring but involves longer operating times (a few seconds)
- The other, based on the use of shunt coils mounted in the devices, which provides virtually instant changes of state.

In practice, the emergency breaking function applied to inversion devices can only be provided without adding any components with the second principle, or by adding control coils with the first principle.



^ DPX supply inverter with motor-driven controls

CONTROL UNITS

Legrand control unit Cat. No. 261 93 is used for simple control of the automatic switching of two sources. Controlled by a microprocessor, it is fully programmable. All the parameters are adjustable: voltage thresholds, switching times, startup of a generator set, etc.


The state of the inverter and the presence of voltages and their values for each source can be constantly monitored via the digital and LED display on the front panel.

Unit Cat. No. 261 94 has the same characteristics and can in addition be controlled remotely using supervision software via a link to a PC.




Supply inverter > control panel with control unit

Front panel of control unit

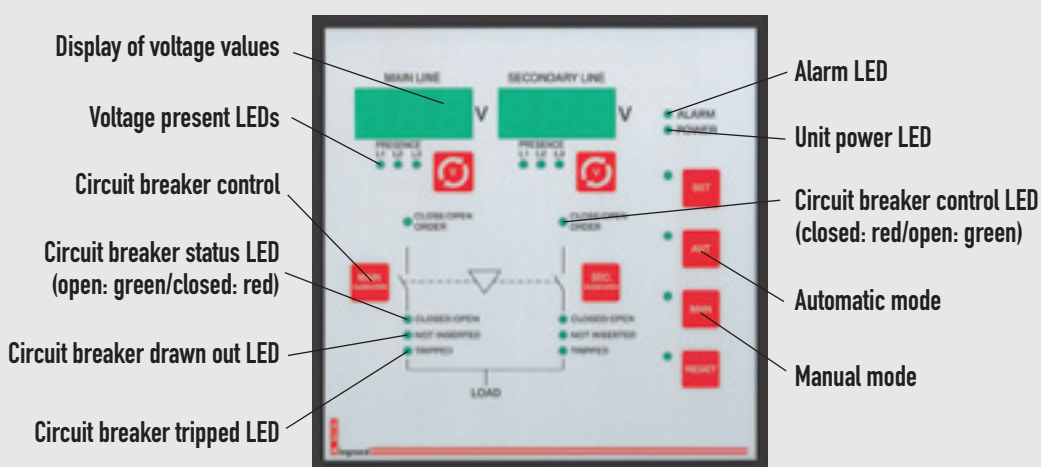

Example of logic diagram of operation for automatic supply inversion

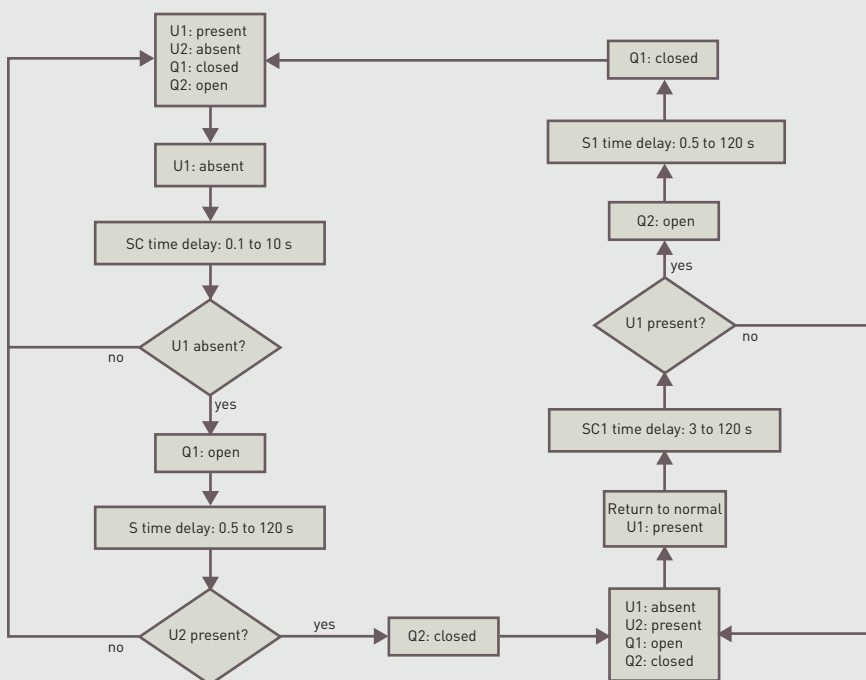

Emergency breaking and stops, isolation

As their name indicates, emergency operations are intended to eliminate, as quickly as possible, a danger which occurs unexpectedly. The emergency break is designed to cut off the electrical power, whereas the emergency stop takes account of the danger of mechanical movements.

EMERGENCY BREAKING

Emergency breaking is normally required for all installations in which there may be faults or risks of electric shocks: laboratories, boiler rooms, kitchens, illuminated signs, pumping of flammable liquids, test platforms, etc.

It must break all live conductors (including neutral, but not PE or PEN).

This must be possible on load and in a single operation.

Standard IEC 60364-5-53 defines the conditions for emergency breaking. Specific regulations can extend its application to other circuits.

In principle, the emergency breaking device should be located on or near the devices(s) to be broken, and be easily identifiable (by operating or emergency staff). On/off functional control devices (such as switches, contactors, circuit breakers) can be used for emergency breaking if they meet the above requirements. It should be noted that in this case, the breaking of single phase (ph + N) terminal circuits is possible with a single pole device. This provision applies in particular to lighting circuits.

The emergency breaking device can be located remotely in the secondary distribution board which supplies all the local circuits, as long as it is easily accessible, identifiable and installed in a location where the danger may occur or be detected.

This provision is designed to avoid accidental operation of the emergency breaking devices by limiting access

to operating staff (for example, in public buildings).

Caution: if the door of the board concerned is closed and locked with a key, a separate mechanical control or an external electrical control is necessary.

In installations in non-industrial or commercial premises, offices (or similar, measuring less than 500 m²), the main control and protection device at the origin of the installation may be used for emergency breaking, if it is easily accessible.

If there is a need for proximity of the device (in view of the dangers) and inaccessibility is required under normal conditions, emergency breaking must be via a "glass break" device with either direct control (pushbutton) or key release.

For the safety of machinery...



...the emergency stop is defined by standard IEC 60204-1 - a red button on a yellow background

For certain areas or equipment (boiler rooms, cooking equipment, large kitchens, illuminated signs, etc.) the emergency breaking must be:

- Either positive safety type (undervoltage release coils)
- Or accompanied by indication of the open/closed state (indicators, etc.) showing the position of the breaking device.

It should be noted that separate lighting devices/other circuits may also be required (for example, in boiler rooms).


It must be possible to lock the emergency break operating device in the off position.

If this is not possible, the operation to release


the emergency break and re-establish the supply must be carried out by the same person. It is therefore recommended that it must only be possible to perform these two operations from two locations that are near to one another and visible.




The requirements relating to emergency breaking, functional control, emergency stops and isolation are described in standard IEC 60364-5-53.

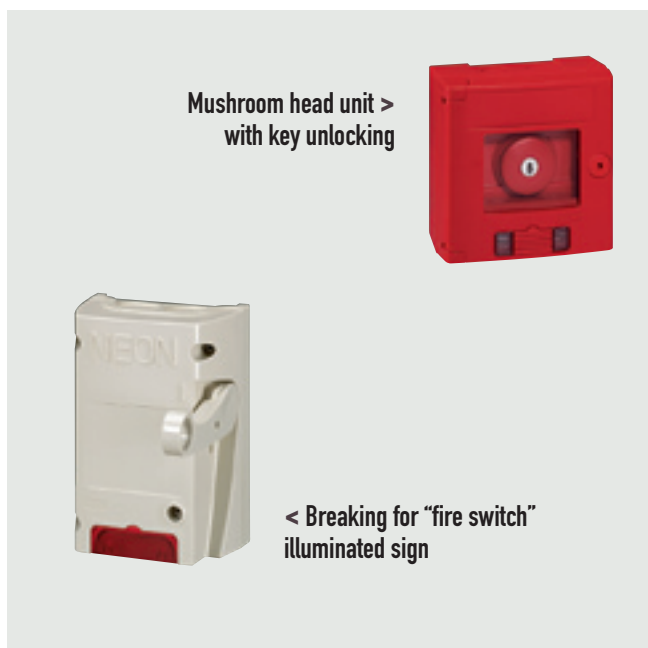


Emergency breaking and stops, isolation (continued)



Accessible direct control: all the breaking devices in the DX, DPX, DPX-IS, Vistop and SPX-D ranges can be used for emergency breaking.



Separate control (if the breaking device is inaccessible or in a panel locked with a key): Vistop, DPX-IS, DPX and SPX-D devices can be equipped with external front or side handles.

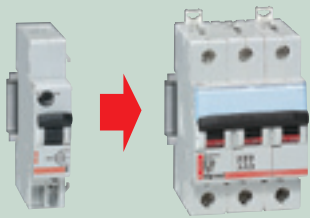

Remote control: DX, DPX and DPX-IS circuit breakers and residual current circuit breakers can be equipped with shunt trips or undervoltage releases.




It must be possible to use emergency breaking methods, other than the emergency stop (see p. 28), to eliminate an unexpected danger. Examples of this include: ventilation or pumping systems, neon signs, certain important buildings, laboratories, boiler rooms, large kitchens, etc.


The notions of positive safety (use of undervoltage releases) and locking in breaking position are required for these uses, as well as the use of clearly identified devices (red on a contrasting background). In practice, the use of undervoltage release devices must be avoided too far upstream of the installation as they lead to breaking of the main circuits when there is a drop in voltage.

However these devices are not necessary for terminal circuits that do not present any particular danger: heating, lighting, power sockets.


Examples of emergency breaking

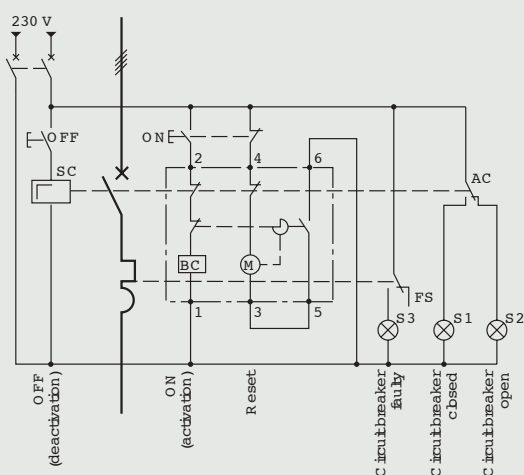


Motor-driven control of a DPX circuit breaker with emergency breaking by the off button OFF and shunt coil. Manual reset.

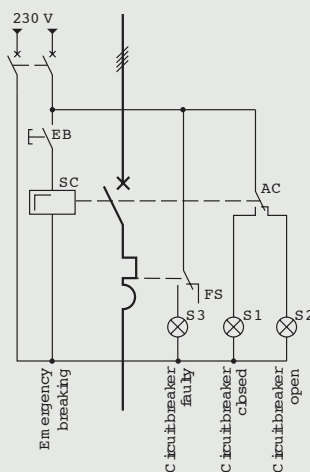

Direct control of a DPX circuit breaker. Emergency breaking is carried out by the off button EB and the shunt coil SC.

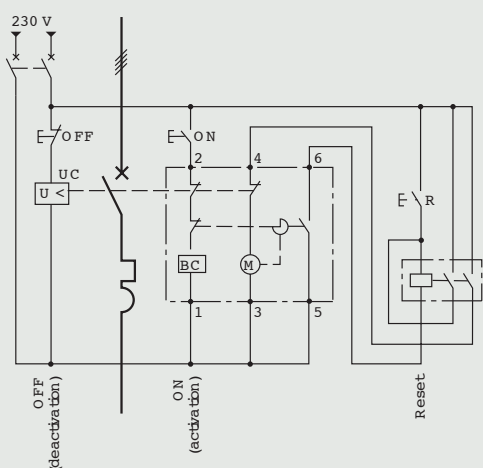

Motor-driven control for DPX circuit breaker with reset by external handle. Opening by undervoltage release.

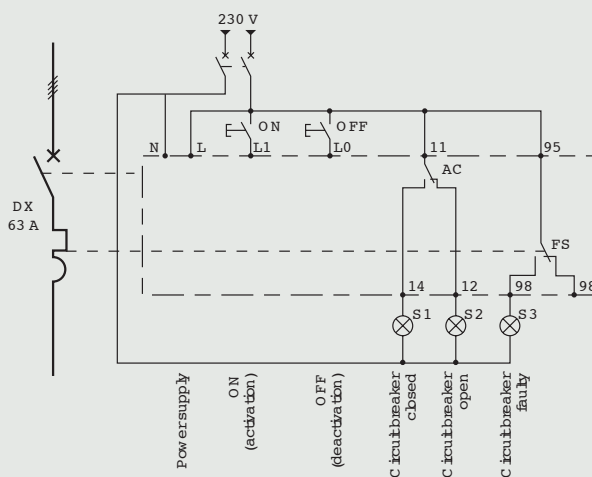

Wiring of motor-driven control Cat. No. 073 70/71/73 for DX circuit breakers. The off button OFF can be used for emergency breaking.

AC: auxiliary contact
 FS: fault signal contact
 SC: shunt coil
 UC: undervoltage coil

EB: emergency breaking
 ON: ON button
 OFF: OFF button
 R: reset

Emergency breaking and stops, isolation (continued)

THE EMERGENCY STOP

When movements produced by electrical devices or machines can be the source of danger, these devices or machines must be equipped with emergency stop device(s) located as close as possible to the users. Emergency stops are required for example for escalators, lifts and elevators, cranes and transporters, electrically controlled doors, car washes, etc. And of course for machines: mechanical kneading machines, handling robots, and machine tools in the broadest sense.

Each machine must be fitted with one or more emergency stop devices, which are clearly identifiable, accessible, in sufficient numbers, avoiding dangerous situations arising or continuing.

The stop can be immediate, controlled or delayed, depending on the requirements of the machine, with the power supply only being cut off when the stop takes place.

The emergency stop is not required:

- If its presence does not reduce the risk

- If the stopping time is not shorter than the emergency break
- For portable machines and manually guided machines.



The emergency stop must be activated by as direct an action as possible and with the notion of “positive safety”: direct action on the contacts opening the circuit or stop given priority in the event of a fault on the equipment or the power supply.



European directive 98/37/EC (concerning machinery) sets technical requirements with which the said machinery and work equipment must comply, including the emergency stop.

Emergency stop for the safety of machinery




Control station with yellow cover and red “push-turn” mushroom head button conforming to standard IEC 60204-1 (1/4 turn to unlock).


Emergency stop devices must be provided for any part of an installation for which it may be necessary to control the power supply in order to eliminate an unexpected danger.

The emergency stop is intended to eliminate a danger, which does not necessarily have an electrical origin, as quickly as possible.


Examples of emergency stops



Conventional layout of supply to a relay with switch-off priority.

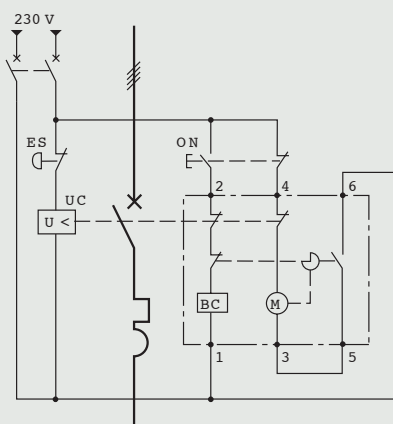

Motor-driven control for DPX circuit breaker with automatic reset after closing of the circuit breaker. Opening by undervoltage coil.

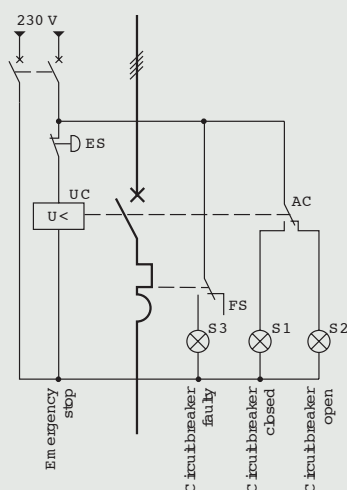

Direct on DPX circuit breaker by "mushroom head" button and undervoltage coil.

AC: auxiliary contact ON: ON button
 FS: fault signal contact ES: emergency stop
 UC: undervoltage coil



Time-lag (800 ms) undervoltage releases prevent unwanted stopping in the event of micro-breaks.

Emergency breaking and stops, isolation (continued)

ISOLATION

Used to separate an installation or part of an installation electrically, the purpose of isolation is to ensure the safety of people working on it.

A breaking device providing the isolation function must be installed:

- At the origin of all installations
 - At the origin of each circuit or group of circuits
- The isolator must break all the live conductors (including the neutral).

PE and PEN must not be broken.

Isolation does not have to be carried in a single operation (commoning links, fuse carriers), although multipole devices are preferable.

If there is a risk of backfeed, isolation upstream and downstream of the installation may be necessary. The devices which carry out isolation may be isolators, isolating switches, circuit breakers, power sockets, fuse carriers, isolating blades, disconnect terminals or any device which provides a minimum contact opening distance of:

- 4 mm for 230/400 V voltage
- 8 mm for 400/690 V voltage
- 11 mm 1000 V voltage

For double break devices, the distances must be multiplied by 1.25.

1 ISOLATION WITH PERMANENT CONTACT INDICATION

This characteristic is checked by reliable control between the position of the contacts and that of the control switch handle. The indication "I" or "O" (red or green) on the handle thus guarantees the actual contact position. Compliance with standard IEC 60947-2 is evidence of this.



Caution: isolation does not on its own ensure that the installation is made safe. Appropriate methods must be employed to prevent any unwanted re-energising (padlocking, signs, locked rooms, earthing) and lock out the installation (see p. 03).



Requirements concerning isolation are also applicable to machines and work equipment that have to be isolated from their power source(s) in order to carry out adjustment operations or maintenance work. European directive 98/37/EC details the requirements: separation, immobilisation and checking in order to lock out the machine or device.

Full load switch units...



...full load switch units carry out both emergency breaking and isolation

2 ISOLATION WITH VISIBLE CONTACT INDICATION


The actual position of the separate contacts is directly visible. Visible contact indication can be obtained by means of a display window (Vistop, DPX-IS) or by using plug-in or draw-out devices (DPX, DMX³).

It is important to clearly identify the local requirements concerning isolation. For example in France visible contact indication is required for subscriber stations whose power does not exceed 1250 kVA, supplied by a single transformer with LV metering. It is also required upstream of the supply point for monitored power connections.



Other definitions

- **Protective breaking:**
Breaking associated with a protective function (overcurrents, residual current fault, overvoltage, etc.).
- **Functional control:**
Control of operation (on, off, variation) for solely functional purposes: thermostats, dimmers and remote control switches are examples of this. Power sockets > 32 A cannot perform functional control of a device. They must be combined with a load breaking device.
- **Breaking for mechanical maintenance:**
Breaking solely intended to avoid mechanical risks (movement) during non-electrical work. If they only have this function, they cannot be used for emergency breaking purposes.

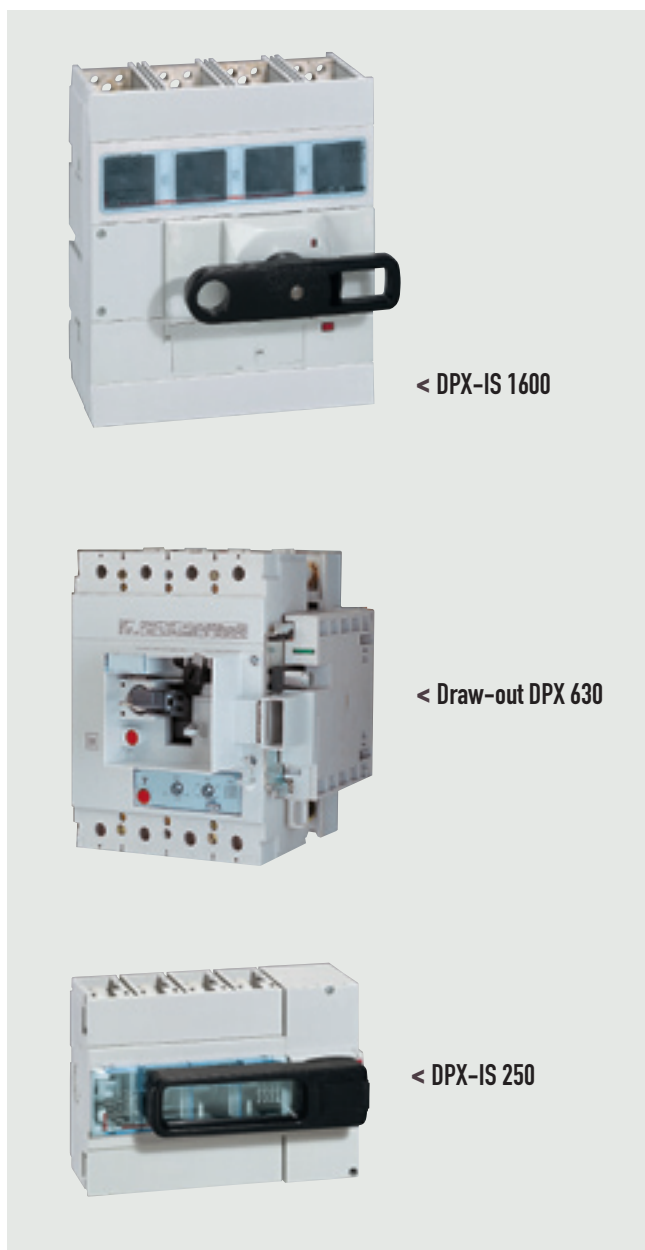

Choice of products



286 56

DMX³ ACBs and DMX³-I TRIP-FREE SWITCHES

| | DMX ³ -N 2500 - 4000 | | | | DMX ³ -H 2500 - 4000 | | | | DMX ³ -L 2500 - 4000 | | | | |
|----------------|---------------------------------|--------|----------|--------|---------------------------------|--------|----------|--------|---------------------------------|--------|----------|--------|--------|
| Icu (400 V AC) | 50 kA | | | | 70 kA | | | | 100 kA | | | | |
| Version | Fixed | | Draw-out | | Fixed | | Draw-out | | Fixed | | Draw-out | | |
| Poles | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | |
| In (A) | 800 | 286 21 | 286 31 | 287 21 | 287 31 | 286 41 | 286 51 | 287 41 | 287 51 | 286 61 | 286 71 | 287 61 | 287 71 |
| | 1000 | 286 22 | 286 32 | 287 22 | 287 32 | 286 42 | 286 52 | 287 42 | 287 52 | 286 62 | 286 72 | 287 62 | 287 72 |
| | 1250 | 286 23 | 286 33 | 287 23 | 287 33 | 286 43 | 286 53 | 287 43 | 287 53 | 286 63 | 286 73 | 287 63 | 287 73 |
| | 1600 | 286 24 | 286 34 | 287 24 | 287 34 | 286 44 | 286 54 | 287 44 | 287 54 | 286 64 | 286 74 | 287 64 | 287 74 |
| | 2000 | 286 25 | 286 35 | 287 25 | 287 35 | 286 45 | 286 55 | 287 45 | 287 55 | 286 65 | 286 75 | 287 65 | 287 75 |
| | 2500 | 286 26 | 286 36 | 287 26 | 287 36 | 286 46 | 286 56 | 287 46 | 287 56 | 286 66 | 286 76 | 287 66 | 287 76 |
| | 3200 | 286 27 | 286 37 | 287 27 | 287 37 | 286 47 | 286 57 | 287 47 | 287 57 | 286 67 | 286 77 | 287 67 | 287 77 |
| 4000 | 286 28 | 286 38 | 287 28 | 287 38 | 286 48 | 286 58 | 287 48 | 287 58 | 286 68 | 286 78 | 287 68 | 287 78 | |

Electronic protection units and accessories

| Electronic protection units | | | Communication module | 12 V dc external power supply | Earth leakage module | External coil for earth leakage module | Module programmable output |
|-----------------------------|---------|----------|----------------------|-------------------------------|----------------------|--|----------------------------|
| MP4 LI | MP4 LSI | MP4 LSIg | | | | | |
| 288 00 | 288 01 | 288 02 | 288 05 | 288 06 | 288 07 | 288 11 | 288 12 |

DMX³-I 2500 - 4000

| Version | Fixed | | Draw-out | | |
|---------|-------|--------|----------|--------|--------|
| Poles | 3P | 4P | 3P | 4P | |
| In (A) | 1250 | 286 83 | 286 93 | 287 83 | 287 93 |
| | 1600 | 286 84 | 286 94 | 287 84 | 287 94 |
| | 2000 | 286 85 | 286 95 | 287 85 | 287 95 |
| | 2500 | 286 86 | 286 96 | 287 86 | 287 96 |
| | 3200 | 286 87 | 286 97 | 287 87 | 287 97 |
| | 4000 | 286 88 | 286 98 | 287 88 | 287 98 |

Conversion of a fixed device into a draw-out device

| Device | DMX ³ /DMX ³ -I 2500 | | DMX ³ /DMX ³ -I 4000 | |
|--------------------------|--|--------|--|--------|
| Poles | 3P | 4P | 3P | 4P |
| Base for draw-out device | 289 02 | 289 03 | 289 04 | 289 05 |
| Transformation kit | 289 09 | 289 10 | 289 11 | 289 12 |



287 56



288 51



288 37



288 82



288 96

Control auxiliaries

| Supply | Shunt trips | Undervoltage releases | Delayed undervoltage releases | Motor operators | Closing coils |
|-------------|-------------|-----------------------|-------------------------------|-----------------|---------------|
| 24 V AC/DC | 288 48 | 288 55 | | 288 34 | 288 41 |
| 48 V AC/DC | 288 49 | 288 56 | | 288 35 | 288 42 |
| 110 V AC/DC | 288 50 | 288 57 | 288 62 | 288 36 | 288 43 |
| 230 V AC/DC | 288 51 | 288 58 | 288 63 | 288 37 | 288 44 |
| 415 V AC | 288 52 | 288 59 | | 288 38 | 288 45 |
| 440 V AC | 288 53 | 288 60 | | 288 39 | 288 46 |
| 480 V AC | 288 54 | 288 61 | | 288 40 | 288 47 |

Locking options

| | Key locking in "open" position | Key locking in "draw-out" position | Door locking | Padlocking in "open" position |
|--|--------------------------------|------------------------------------|--------------|-------------------------------|
| Ronis lock | 288 30 | 288 33 | | |
| Profalux lock | 288 31 | 288 32 | | |
| 2 hole support frame for above locks | 288 28 | | | |
| Left-hand and right-hand side mounting | | | 288 20 | |
| Padlocking system for ACBs | | | | 288 21 |
| Padlocking system for safety shutters | | | | 288 26 |

Equipment for supply invertors

| | Interlocking mechanism | Interlocking cable | | | | | | Automation control unit | |
|-----------------------|------------------------|--------------------|--------|--------|--------|--------|--------|-------------------------|---------------|
| | | Type 1 | Type 2 | Type 3 | Type 4 | Type 5 | Type 6 | Standard | Communicating |
| DMX ³ 2500 | 288 64 | 289 20 | 289 21 | 289 21 | 289 21 | 289 21 | 289 21 | 261 93 | 261 94 |
| DMX ³ 4000 | 288 65 | | | | | | | | |

Accessories for connexion with bars

| Accessories | Connexion | DMX ³ 2500 | | | | DMX ³ 4000 | | | |
|----------------|------------|-----------------------|--------|------------------|--------|-----------------------|--------|------------------|--------|
| | | Fixed version | | Draw-out version | | Fixed version | | Draw-out version | |
| | | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P |
| Rear terminals | Flat | 288 84 | 288 85 | | | 288 92 | 288 93 | | |
| | Vertical | 288 82 | 288 83 | 288 96 | 288 97 | | | 288 94 | 288 95 |
| | Horizontal | | | 288 96 | 288 97 | | | 288 94 | 288 95 |
| Spreaders | Flat | 288 86 | 288 87 | | | 288 86 | 288 87 | | |
| | Vertical | 288 88 | 288 89 | | | 288 88 | 288 89 | | |
| | Horizontal | 288 90 | 288 91 | | | 288 90 | 288 91 | | |



6261 29



6261 17

DMX-E AIR CIRCUIT BREAKERS

| | | DMX-E 55 | | | | DMX-E 65 | | | |
|----------------|------|----------|---------|----------|---------|----------|---------|----------|---------|
| Icu (415 V AC) | | 55 kA | | | | 65 kA | | | |
| Version | | Fixed | | Draw-out | | Fixed | | Draw-out | |
| Poles | | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P |
| In (A) | 800 | 6260 02 | 6260 12 | 6260 22 | 6260 32 | 6260 42 | 6260 52 | 6260 62 | 6260 72 |
| | 1000 | 6260 03 | 6260 13 | 6260 23 | 6260 33 | 6260 43 | 6260 53 | 6260 63 | 6260 73 |
| | 1250 | 6260 04 | 6260 14 | 6260 24 | 6260 34 | 6260 44 | 6260 54 | 6260 64 | 6260 74 |
| | 1600 | 6260 05 | 6260 15 | 6260 25 | 6260 35 | 6260 45 | 6260 55 | 6260 65 | 6260 75 |
| | 2000 | | | | | 6260 46 | 6260 56 | 6260 66 | 6260 76 |
| | 2500 | | | | | 6260 47 | 6260 57 | 6260 67 | 6260 77 |

| | | DMX-E 80 | | | | DMX-E 100 | | | |
|----------------|------|----------|---------|----------|---------|-----------|---------|----------|---------|
| Icu (415 V AC) | | 80 kA | | | | 100 kA | | | |
| Version | | Fixed | | Draw-out | | Fixed | | Draw-out | |
| Poles | | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P |
| In (A) | 2000 | 6260 86 | 6260 96 | 6261 06 | 6261 16 | 6261 26 | 6261 36 | 6261 46 | 6261 56 |
| | 2500 | 6260 87 | 6260 97 | 6261 07 | 6261 17 | 6261 27 | 6261 37 | 6261 47 | 6261 57 |
| | 3200 | 6260 88 | 6260 98 | 6261 08 | 6261 18 | 6261 28 | 6261 38 | 6261 48 | 6261 58 |
| | 4000 | 6260 89 | 6260 99 | 6261 09 | 6261 19 | 6261 29 | 6261 39 | 6261 49 | 6261 59 |

Conversion of a fixed device into a draw-out device

| In | Bases for draw-out device | | | | | | | | Rear terminals (supplied singly) | |
|-----------------|---------------------------|---------|----------|---------|----------|---------|-----------|---------|----------------------------------|----------|
| | DMX-E 55 | | DMX-E 65 | | DMX-E 80 | | DMX-E 100 | | Horizontal | Vertical |
| | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | | |
| 800 to 1600 A | 6263 86 | 6263 87 | 6263 86 | 6263 87 | | | | | 6263 30 | 6263 30 |
| 2000 and 2500 A | | | 6263 88 | 6263 89 | 6263 88 | 6263 89 | 6263 90 | 6263 91 | 6263 31 | 6263 32 |
| 3200 and 4000 A | | | | | 6263 90 | 6263 91 | 6263 90 | 6263 91 | 6263 30 | 6263 30 |

Interlocking mechanism for supply invertors

| 1 standard power supply + 1 standby power supply | 3 power supplies | 2 standard power supplies + 1 standby power supply | 2 standard power supplies + 1 coupler |
|--|------------------|--|---------------------------------------|
| 6263 80 | 6263 81 | 6263 82 | 6263 83 |

Control auxiliaries

| Supply | | Shunt trips | Undervoltage releases | Delayed undervoltage releases | Motor operators | Closing coils |
|-------------|-----------|-------------|-----------------------|-------------------------------|-----------------|---------------|
| DC | 24/30 V | 6262 60 | 6262 70 | | 6262 91 | 6263 00 |
| | 48 V | | 6262 71 | 6262 81 | 6262 92 | 6263 01 |
| | 60 V | | | | 6262 92 | 6263 01 |
| | 110 V | 6262 62 | 6262 74 | 6262 84 | 6262 93 | 6263 02 |
| | 125 V | | | | 6262 93 | |
| | 220 V | 6262 64 | | | | 6263 04 |
| | 250 V | 6262 64 | | | 6262 95 | 6263 04 |
| AC 50 Hz | 400 V | | | | 6262 96 | |
| | 110 V | 6262 62 | 6262 72 | 6262 82 | 6262 93 | 6263 02 |
| | 220 V | 6262 64 | | | | |
| | 240 V | 6262 64 | 6262 77 | 6262 87 | 6262 95 | 6263 04 |
| | 250 V | | | | | |
| | 380 V | | 6262 79 | 6262 89 | 6262 96 | |
| AC 60 Hz | 415 V | 6262 65 | 6262 79 | 6262 89 | 6262 96 | 6263 05 |
| | 110 V | 6262 62 | 6262 73 | 6262 83 | 6262 93 | 6263 02 |
| | 220 V | 6262 64 | | | | 6263 04 |
| | 240 V | 6262 64 | 6262 78 | 6262 88 | 6262 95 | 6263 04 |
| | 380/415 V | 6262 65 | 6262 80 | 6262 90 | 6262 96 | 6263 05 |

Signalling auxiliaries

| Position signal contact | Fault signal contact | True "ready to close" contact | Shunt release action signal contact | Undervoltage release action signal contact |
|-------------------------|----------------------|-------------------------------|-------------------------------------|--|
| 6263 11 | 6263 17 | 6263 18 | 6263 15 | 6263 16 |

Locking options

| For lock (not supplied) | Key locking in "open" position | Key locking in "draw-out" position | Door locking |
|-------------------------|--------------------------------|------------------------------------|--------------|
| Ronis | 6263 40 | 6263 45 | |
| Profalux | 6263 41 | 6263 46 | |
| Castell | 6263 42 | 6263 47 | |
| Kirk | 6263 43 | 6263 48 | |
| None | | | 6263 22 |

Accessories

| Rating mis-insertion device | Operation counter | Test box |
|-----------------------------|-------------------|----------|
| 6263 20 | 6263 24 | 6263 79 |



250 18



250 59

DPX CIRCUIT BREAKERS AND DPX-I TRIP-FREE SWITCHES

| DPX-E 125 and DPX 125 | | | | | | | | | | |
|-----------------------|-------|--------|----------|--------|--------|--------|--------|----------|--------|--------|
| Icu (400 V)* | 16 kA | | | | 25 kA | | 36 kA | | | |
| Poles | 1P | 3P | 3P + ½ N | 4P | 3P | 4P | 3P | 3P + ½ N | 4P | |
| In (A) | 16 | 250 00 | 250 16 | | 250 24 | 250 36 | 250 44 | 250 50 | | 250 58 |
| | 20 | 250 01 | | | | | | | | |
| | 25 | 250 02 | 250 17 | | 250 25 | 250 37 | 250 45 | 250 51 | | 250 59 |
| | 32 | 250 03 | | | | | | | | |
| | 40 | 250 04 | 250 18 | | 250 26 | 250 38 | 250 46 | 250 52 | | 250 60 |
| | 50 | 250 05 | | | | | | | | |
| | 63 | 250 06 | 250 19 | | 250 27 | 250 39 | 250 47 | 250 53 | | 250 61 |
| | 80 | 250 07 | | | | | | | | |
| | 100 | 250 08 | 250 20 | | 250 28 | 250 40 | 250 48 | 250 54 | | 250 62 |
| | 125 | 250 09 | 250 21 | 250 23 | 250 29 | 250 41 | 250 49 | 250 55 | 250 57 | 250 63 |

* 230 V for 1P devices

| DPX 160 | | | | | | | | | |
|-------------|-------|----------|--------|--------|----------|--------|--------|----------|--------|
| Icu (400 V) | 25 kA | | | 36 kA | | | 50 kA | | |
| Poles | 3P | 3P + ½ N | 4P | 3P | 3P + ½ N | 4P | 3P | 3P + ½ N | 4P |
| In (A) | 40 | | | | | | 251 62 | | 251 70 |
| | 63 | 251 23 | | 251 31 | 251 49 | | 251 57 | 251 63 | 251 71 |
| | 100 | 251 24 | | 251 32 | 251 50 | | 251 58 | 251 64 | 251 72 |
| | 160 | 251 25 | 251 27 | 251 33 | 251 51 | 251 53 | 251 59 | 251 65 | 251 73 |

| DPX 250 ER | | | | | | | | | |
|-------------|-------|----------|--------|--------|----------|--------|--------|----------|--------|
| Icu (400 V) | 25 kA | | | 36 kA | | | 50 kA | | |
| Poles | 3P | 3P + ½ N | 4P | 3P | 3P + ½ N | 4P | 3P | 3P + ½ N | 4P |
| In (A) | 100 | 252 04 | | 252 14 | 252 24 | | 252 34 | 252 44 | 252 54 |
| | 160 | 252 05 | | 252 15 | 252 25 | | 252 35 | 252 45 | 252 55 |
| | 250 | 252 06 | 252 09 | 252 16 | 252 26 | 252 29 | 252 36 | 252 46 | 252 56 |



254 23



256 32



257 32

DPX 250

| Release | Thermal magnetic | | | | | | Electronic | | | | |
|-------------|------------------|----------|--------|--------|----------|--------|------------|--------|--------|--------|--------|
| Icu (400 V) | 36 kA | | | 70 kA | | | 36 kA | | 70 kA | | |
| Poles | 3P | 3P + ½ N | 4P | 3P | 3P + ½ N | 4P | 3P | 4P | 3P | 4P | |
| In (A) | 40 | 253 28 | | 253 45 | 253 52 | | 253 69 | 254 01 | 254 07 | 254 13 | 254 19 |
| | 63 | 253 29 | | 253 46 | 253 53 | | 253 70 | | | | |
| | 100 | 253 30 | | 253 47 | 253 54 | | 253 71 | 254 03 | 254 09 | 254 15 | 254 21 |
| | 160 | 253 31 | 253 41 | 253 48 | 253 55 | | 253 72 | 254 04 | 254 10 | 254 16 | 254 22 |
| | 250 | 253 32 | 253 42 | 253 49 | 253 56 | 253 66 | 253 73 | 254 05 | 254 11 | 254 17 | 254 23 |

DPX 630

| Release | Thermal magnetic | | | | | | Electronic | | | | |
|-------------|------------------|---------|--------|--------|----------|--------|------------|--------|--------|--------|--------|
| Icu (400 V) | 36 kA | | | 70 kA | | | 36 kA | | 70 kA | | |
| Poles | 3P | 3P + ½N | 4P | 3P | 3P + ½ N | 4P | 3P | 4P | 3P | 4P | |
| In (A) | 250 | 255 21 | | 255 36 | | | 256 01 | 256 05 | | | |
| | 320 | 255 22 | 255 32 | 255 37 | 255 42 | 255 52 | 255 57 | | | | |
| | 400 | 255 23 | 255 33 | 255 38 | 255 43 | 255 53 | 255 58 | 256 02 | 256 06 | 256 10 | 256 14 |
| | 500 | 255 25 | 255 35 | 255 39 | 255 45 | 255 55 | 255 59 | | | | |
| | 630 | 255 24 | 255 34 | 255 40 | 255 44 | 255 54 | 255 60 | 256 03 | 256 07 | 256 11 | 256 15 |

DPX 1250 - 1600


| Release | Thermal magnetic | | | | Electronic S1 | | | | Electronic S2 | | | | |
|-------------|------------------|--------|--------|--------|---------------|--------|--------|--------|---------------|--------|--------|--------|--------|
| Icu (400 V) | 50 kA | | 70 kA | | 50 kA | | 70 kA | | 50 kA | | 70 kA | | |
| Poles | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | |
| In (A) | 800 | 258 02 | 258 09 | 258 16 | 258 23 | 257 02 | 257 06 | 257 10 | 257 14 | 257 26 | 257 30 | 257 34 | 257 38 |
| | 1000 | 258 03 | 258 10 | 258 17 | 258 24 | | | | | | | | |
| | 1250 | 258 04 | 258 11 | 258 18 | 258 25 | 257 03 | 257 07 | 257 11 | 257 15 | 257 27 | 257 31 | 257 35 | 257 39 |
| | 1600 | | | | | 257 04 | 257 08 | 257 12 | 257 16 | 257 28 | 257 32 | 257 36 | 257 40 |



253 99



265 32

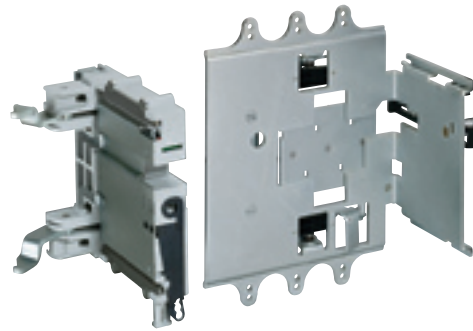

265 46

DPX-I trip-free switches

| In (A) | DPX-I 125 | | DPX-I 160 | | DPX-I 250 ER | | DPX-I 250 | | DPX-I 630 | | DPX-I 1600 | |
|--------|-----------|--------|-----------|--------|--------------|--------|-----------|--------|-----------|--------|------------|--------|
| | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P |
| 125 | 250 98 | 250 99 | | | | | | | | | | |
| 160 | | | 251 98 | 251 99 | | | | | | | | |
| 250 | | | | | 252 98 | 252 99 | 253 98 | 253 99 | | | | |
| 400 | | | | | | | | | 255 86 | 255 87 | | |
| 630 | | | | | | | | | 255 88 | 255 89 | | |
| 800 | | | | | | | | | | | 257 94 | 257 95 |
| 1250 | | | | | | | | | | | 257 96 | 257 97 |
| 1600 | | | | | | | | | | | 257 98 | 257 99 |

Equipment and accessories for plug-in and draw-out version

| Devices | | DPX 250 ER | | DPX 250 | | | DPX 630 | | | DPX 1600 | | |
|---|----------------------------------|------------|--------|---------|--------|---------------------------|---------|--------|---------------------------|----------|--------|--------|
| | | 3P | 4P | 3P | 4P | 4P + earth leakage module | 3P | 4P | 4P + earth leakage module | 3P | 4P | |
| Fixed version to plug-in version | Tulip contacts | 265 12 | 265 13 | 265 29 | 265 30 | | 265 50 | 265 51 | | | | |
| | Front terminal mounting base | 265 14 | 265 15 | 265 31 | 265 32 | 265 37 | 265 52 | 265 53 | 265 58 | | | |
| | Rear terminal mounting base | 265 16 | 265 17 | 265 33 | 265 34 | 265 38 | 265 54 | 265 55 | 265 59 | | | |
| | Flat rear terminal mounting base | | | 265 35 | 265 36 | 265 39 | 265 56 | 265 57 | 265 60 | | | |
| Fixed version to draw-out version (mounting base + tulip contacts + "Debro-lift" mechanism) | Front terminal | | | | | | | | | | 265 82 | 265 83 |
| | Rear terminal | | | | | | | | | | 265 84 | 265 85 |
| Plug-in version to draw-out version ("Debro-lift" mechanism) | | | | 265 45 | 265 46 | 265 47 | 265 66 | 265 67 | 265 68 | | | |
| Set of connectors (6 pins) | | | | | 098 19 | | | | | | | |
| Set of connectors (8 pins) | | | 263 99 | | 263 99 | | | | 263 99 | | | |
| Extractor handles (set of 2) | | | | | 263 43 | | | | 263 68 | | | |
| Isolated handle for drawing-out | | | | | 265 75 | | | | 265 75 | | 265 75 | |
| Signalling contact plugged-in/drawn-out | | | | | 265 74 | | | | 265 74 | | 265 74 | |
| Key lock for "Debro-lift" mechanism | DPX only | | | | 265 76 | | | | 265 76 | | 265 76 | |
| | motorised DPX or rotary handle | | | | 265 78 | | | | 265 78 | | 265 80 | |



262 50 262 11 262 79 261 73 261 90

Accessories, rotary and motor driven handles


| | | DPX 125 DPX-I 125 | DPX 160 DPX-I 160 | DPX 250 ER | DPX 250 | DPX 630 | DPX 1600 |
|-----------------------------|-----------------------------|----------------------|----------------------|------------|--------------------------|-----------------------|--------------------------|
| Sealable terminal shields | 3P | 262 05 | 262 15 | 262 85 | 262 26/28 ⁽¹⁾ | 262 44 | 262 64 |
| | 4P | 262 06 | 262 16 | 262 86 | 262 27/29 ⁽¹⁾ | 262 45 | 262 65 |
| Insulated shield | set of 3 | | | | 262 30 | 262 30 | 262 66 |
| Padlocking accessory | | 262 00 | 262 10 | 262 10 | 262 21 | 262 40 | 262 60 |
| Cage terminal | | Supplied | 262 18 | 262 88 | 262 35 | 262 50 | 262 69 |
| High capacity cage terminal | | | 262 19 | | | 262 51 | 262 70 |
| Adaptator for lug | | | | | 262 31 | 262 46 | |
| Extended front terminals | | | 262 17 | | 262 32 | 262 47 | 262 67/68 ⁽²⁾ |
| Spreaders | 3P | | | 262 90 | 262 33 | 262 48 | 262 73 |
| | 4P | | | 262 91 | 262 34 | 262 49 | 262 74 |
| Swivel rear terminals | 3P | 263 00 | 263 10 | 265 10 | 263 31 | 263 50 | |
| | 4P | 263 01 | 263 11 | 265 11 | 263 32 | 263 51 | |
| Flat rear terminals | 3P | | | | 265 27 | 263 52 | 263 80/81 ⁽³⁾ |
| | 4P | | | | 265 28 | 263 53 | 263 82/83 ⁽³⁾ |
| Direct rotary handle | standard | 262 01 | 262 11 | 262 11 | 262 22 | 262 41 | 262 61 |
| | for emergency use | 262 03 | 262 13 | 262 13 | 262 24 ⁽⁴⁾ | 262 24 ⁽⁴⁾ | |
| | Eurolocks locking accessory | 262 25 | 262 25 | 262 25 | | 262 25 | 262 25 |
| Vari-depth handle | standard | 262 75 | 262 77 | 262 77 | 262 79 | 262 81 | 262 83 |
| | for emergency use | 262 76 | 262 78 | 262 78 | 262 80 ⁽⁴⁾ | 262 82 ⁽⁴⁾ | 262 84 |
| | Eurolocks locking accessory | 262 92 | 262 92 | 262 92 | 262 92 | 262 92 | 262 92 |
| | Profalux locking accessory | 262 93 | 262 93 | 262 93 | 262 93 | 262 93 | 262 93 |
| | Ronis locking accessory | 262 94 | 262 94 | 262 94 | 262 94 | 262 94 | 262 94 |
| Motor driven handle | 24 V | | | | 261 30 | 261 40 | |
| | 230 V | | | | 261 34 | 261 44 | 261 54 |
| | Ronis locking accessory | | | | 261 59 | 261 59 | 261 59 |

Auxiliaries

| Supply | Auxiliary contact or fault signal | Shunt releases | Undervoltage releases | | Time lag undervoltage releases | | |
|----------|-----------------------------------|----------------|-----------------------------|--|--------------------------------|---------------------------------|-------------------------------------|
| | | | for DPX 125, DPX-IS 250/630 | for DPX 160 to DPX 1600, DX-IS 1600, DPX-I | Time lag module | Release for DPX-IS, DPX 125/630 | Releases for DPX 250 ER to DPX 1600 |
| | 261 60 | | | | | 261 75 | 261 85 |
| 24 V AC | | 261 64 | 261 70 | 261 80 | | | |
| 24 V DC | | 261 64 | 261 71 | 261 81 | | | |
| 48 V AC | | 261 65 | | | | | |
| 48 V DC | | 261 65 | 261 72 | 261 82 | | | |
| 110 V AC | | 261 66 | 261 76 | 261 86 | | | |
| 110 V DC | | 261 66 | | | | | |
| 230 V AC | | 261 67 | 261 73 | 261 83 | 261 90 | | |
| 230 V DC | | 261 67 | | | | | |
| 400 V AC | | 261 68 | 261 74 | 261 84 | 261 91 | | |
| 400 V DC | | 261 68 | | | | | |

(1) Long/short | (2) In ≤ 1250 A: Cat.No 262 67 - In = 1600 A: Cat.No 262 68 | (3) Short/long

(4) To be fit on Cat.No 262 22

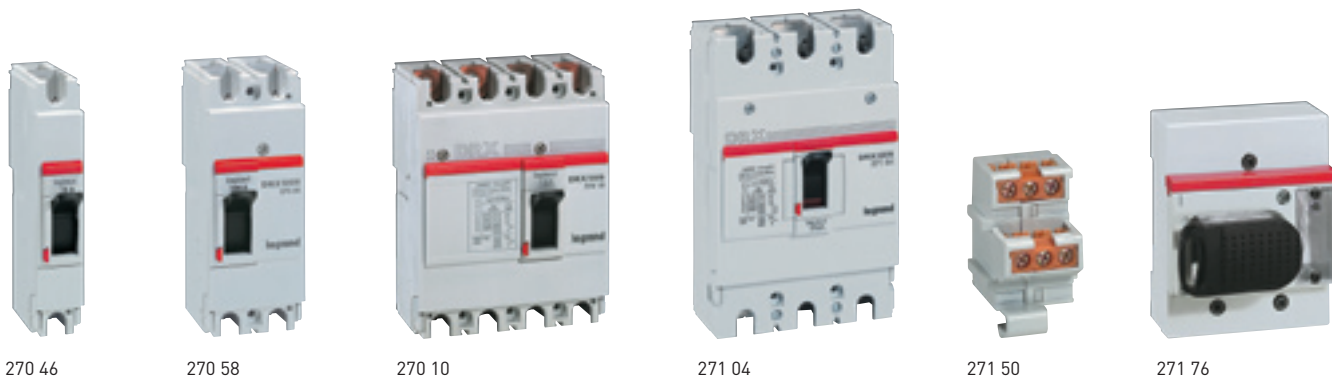

DRX CIRCUIT BREAKERS

| DRX 100 | | | | | | | | | |
|-------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Icu (415 V) | 10 kA | | 20 kA | | 25 kA | 35 kA | | | |
| Poles | 3P | 4P | 3P | 4P | 1P | 2P | 3P | 4P | |
| In (A) | 15 | 270 00 | 270 10 | 270 20 | 270 30 | 270 40 | 270 50 | 270 60 | 270 70 |
| | 20 | 270 01 | 270 11 | 270 21 | 270 31 | 270 41 | 270 51 | 270 61 | 270 71 |
| | 25 | 270 02 | 270 12 | 270 22 | 270 32 | 270 42 | 270 52 | 270 62 | 270 72 |
| | 30 | 270 03 | 270 13 | 270 23 | 270 33 | 270 43 | 270 53 | 270 63 | 270 73 |
| | 40 | 270 04 | 270 14 | 270 24 | 270 34 | 270 44 | 270 54 | 270 64 | 270 74 |
| | 50 | 270 05 | 270 15 | 270 25 | 270 35 | 270 45 | 270 55 | 270 65 | 270 75 |
| | 60 | 270 06 | 270 16 | 270 26 | 270 36 | 270 46 | 270 56 | 270 66 | 270 76 |
| | 75 | 270 07 | 270 17 | 270 27 | 270 37 | 270 47 | 270 57 | 270 67 | 270 77 |
| 100 | 270 08 | 270 18 | 270 28 | 270 38 | 270 48 | 270 58 | 270 68 | 270 78 | |

| DRX 250 | | | | | | | |
|-------------|-------|--------|--------|--------|--------|--------|--------|
| Icu (415 V) | 18 kA | | 25 kA | | 36 kA | | |
| Poles | 3P | 4P | 3P | 4P | 3P | 4P | |
| In (A) | 125 | 271 00 | 271 06 | 271 12 | 271 18 | 271 24 | 271 30 |
| | 150 | 271 01 | 271 07 | 271 13 | 271 19 | 271 25 | 271 31 |
| | 175 | 271 02 | 271 08 | 271 14 | 271 20 | 271 26 | 271 32 |
| | 200 | 271 03 | 271 09 | 271 15 | 271 21 | 271 27 | 271 33 |
| | 225 | 271 04 | 271 10 | 271 16 | 271 22 | 271 28 | 271 34 |

| Electrical accessories | | | | | |
|------------------------|------------------------|--------------|----------------------------|-------------|-----------------------|
| Supply | Auxiliary contact bloc | | | Shunt trips | Undervoltage releases |
| | with 1 auxiliary | with 1 alarm | with 1 auxiliary + 1 alarm | | |
| Up to 250 V AC/DC | 271 40 | 271 41 | 271 42 | | |
| 12 V AC/DC | | | | 271 50 | 271 60 |
| 24 V AC/DC | | | | 271 51 | 271 61 |
| 48 V AC/DC | | | | 271 52 | 271 62 |
| 110/130 V AC | | | | 271 53 | 271 63 |
| 200/240 V AC | | | | 271 54 | 271 64 |
| 277 V AC | | | | 271 54 | 271 67 |
| 380/415 V AC | | | | 271 55 | 271 65 |
| 440/480 V AC | | | | 271 55 | 271 66 |

| Connection accessories, padlocking and rotary handles | | | | | |
|---|-------------------|--------|--------|---------|--------|
| Device | DRX 100 | | | DRX 250 | |
| Poles | 2P | 3P | 4P | 3P | 4P |
| Insulating shields | | 271 81 | 271 82 | 271 81 | 271 82 |
| Seasable terminal shields | 271 91 | 271 83 | 271 84 | 271 85 | 271 86 |
| Cage terminal* | Up to 50 A | 271 70 | 271 72 | | |
| | from 60 to 100 A | 271 71 | 271 73 | | |
| | Up to 250 A | | | 271 74 | 271 75 |
| Padlocking system (up to 3 padlocks) | | 271 80 | | 271 81 | |
| | Direct on DRX | | 271 76 | | 271 78 |
| Rotary handle | | | | | |
| | Vari-depth handle | | 271 77 | | 271 79 |

* Available by set of 60 pieces: Cat.No 271 92 (up to 50 A), Cat.No 271 93 (60 to 100 A), Cat.No 271 94 (up to 250 A)



266 70



255 98



225 15

DPX-IS AND VISTOP ISOLATING SWITCHES

DPX-IS isolating switches

| Model | In (A) | With release | | | | | | Without release | | | | | |
|-------------|--------|--------------|--------|------------------------|--------|-----------------------|--------|-----------------|--------|------------------------|--------|-----------------------|--------|
| | | Front handle | | Right-hand side handle | | Left-hand side handle | | Front handle | | Right-hand side handle | | Left-hand side handle | |
| | | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P | 3P | 4P |
| DPX-IS 250 | 63 | 266 30 | 266 34 | 266 40 | 266 44 | 266 50 | 266 54 | | | | | | |
| | 100 | 266 31 | 266 35 | 266 41 | 266 45 | 266 51 | 266 55 | | | | | | |
| | 160 | 266 32 | 266 36 | 266 42 | 266 46 | 266 52 | 266 56 | 266 02 | 266 06 | 266 12 | 266 16 | 266 22 | 266 26 |
| | 250 | 266 33 | 266 37 | 266 43 | 266 47 | 266 53 | 266 57 | 266 03 | 266 07 | 266 13 | 266 17 | 266 23 | 266 27 |
| DPX-IS 630 | 400 | 266 72 | 266 74 | 266 76 | 266 78 | 266 80 | 266 82 | 266 60 | 266 62 | 266 64 | 266 66 | 266 68 | 266 70 |
| | 630 | 266 73 | 266 75 | 266 77 | 266 79 | 266 81 | 266 83 | 266 61 | 266 63 | 266 65 | 266 67 | 266 69 | 266 71 |
| DPX-IS 1600 | 800 | 265 91 | 265 95 | | | | | | | | | | |
| | 1000 | 265 92 | 265 96 | | | | | | | | | | |
| | 1250 | 265 93 | 265 97 | | | | | | | | | | |
| | 1600 | 265 94 | 265 98 | | | | | | | | | | |

Vistop isolating switches


| Mounting | In (A) | Front handle | | | Side handle | | | Auxiliary contact for on/off signalling |
|----------------------|--------|--------------|--------|--------|-------------|--------|--------|---|
| | | 2 P | 3 P | 4 P | 2 P | 3 P | 4 P | |
| On faceplate | 32 | 224 98 | 225 00 | 225 02 | 225 03 | 225 05 | 225 07 | |
| On faceplate or rail | 63 | | 225 12 | 225 15 | | 225 16 | 225 18 | 227 07 |
| | 100 | | 225 20 | 225 22 | | 225 25 | 225 27 | |
| | 125 | | 225 34 | 225 39 | | 225 44 | 225 46 | |
| | 160 | | 225 51 | 225 53 | | 225 54 | 225 56 | |

Accessories

| | | DPX-IS 250 | DPX-IS 630 | DPX-IS 1600 | Vistop 63 to 160 A |
|---|---------------------------|------------|------------|-------------|--------------------|
| Direct handle for emergency use | front and right-hand side | 266 89 | 266 89 | | |
| | left-hand side | 266 90 | 266 90 | | |
| Vari-depth handle | for standard handle | 266 86 | 266 86 | 265 89 | |
| | for emergency handle | 266 87 | 266 87 | 265 90 | |
| Front external handle | | | | | 227 32 |
| Palock | Ronis | 266 92 | 266 97 | | |
| | Euro locks | | | 262 92 | |
| | Profalux | | | 262 93 | |
| Locking accessories for vari-depth handle | Ronis | | | 262 94 | |
| | 2P | 262 87 | 262 45 | 262 64 | |
| | 3P | | | 262 65 | |
| Insulation shields | | | | 262 66 | |



208 92

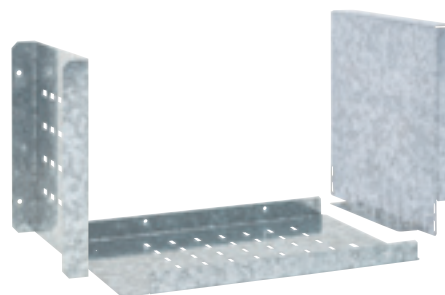

208 75

XL³ 4000 FORMS

Forms equipment selection

| Designation | Complementary information | Forms of separation and type of connection (terminals) | | | | | | | |
|---|--|--|----------------------|---------------------|---------------------|----------------------|---------------------|----------------------|---------------------|
| | | 2a rear terminal | 2b front terminal | 2b rear terminal | 3a rear terminal | 3b front terminal | 3b rear terminal | 4a front terminal | 4b rear terminal |
| Top or bottom horizontal separation kit | width 24 modules | 208 91 | | | | 208 91 | 208 91 | 208 91 | 208 91 |
| | width 36 modules | 208 99 | | | | 208 99 | 208 99 | 208 99 | 208 99 |
| Front panel separation DMX ³ 2500 | width 24 modules | 208 08 | | | 208 08 | | | | |
| Front panel separation DMX ³ 4000 | width 36 modules | 208 09 | | | 208 09 | | | | |
| Front panel side separation | | | | | 208 68 | | 208 68 | | 208 68 |
| Horizontal separation for functional units | width 24 modules | | | 208 92 | 208 92 | 208 92 | 208 92 | 208 92 | 208 92 |
| | width 36 modules | | | 205 92 | 205 92 | 205 92 | 205 92 | 205 92 | 205 92 |
| Kit for vertical separation between enclosure and cable sleeve | depth 475 mm | | 208 27 | | | 208 27 | | 208 27 | |
| | depth 725 mm | | 208 28 | | | 208 28 | | 208 28 | |
| | depth 975 mm | | 208 29 | | | 208 29 | | 208 29 | |
| Kit for vertical separation between internal cable sleeve and external cable sleeve | depth 475 mm | | 208 37 | | | 208 37 | | 208 37 | |
| | depth 725 mm | | 208 38 | | | 208 38 | | 208 38 | |
| | depth 975 mm | | 208 39 | | | 208 39 | | 208 39 | |
| L-shaped separation kit for horizontal busbars 1600 A max. | depth 475 mm | | 205 36 | | | 205 36 | | 205 36 | |
| U-shaped separation kit for horizontal busbars 1600 A max. | depth 725 mm | | 205 37 | | | 205 37 | | 205 37 | |
| L-shaped separation kit for horizontal busbars 4000 A max. | depth 725 mm | | 205 38 | | | 205 38 | | 205 38 | |
| U-shaped separation kit for horizontal busbars 4000 A max. | depth 975 mm | | 205 39 | | | 205 39 | | 205 39 | |
| U-shaped separation kit for horizontal busbars 1600 A max. | internal cable sleeves depth 475 mm | | 208 70 | | | 208 70 | | 208 70 | |
| | internal cable sleeves depth 725 mm | | 208 71 | | | 208 71 | | 208 71 | |
| U-shaped separation kit for horizontal busbars 4000 A max. | internal cable sleeves depth 725 mm | | 208 72 | | | 208 72 | | 208 72 | |
| | internal cable sleeves depth 975 mm | | 208 76 | | | 208 76 | | 208 76 | |

Forms equipment selection (continued)

| Designation | Complementary information | Forms of separation and type of connection (terminals) | | | | | | | |
|--|--|--|----------------|---------------|---------------|----------------|---------------|----------------|---------------|
| | | 2a | 2b | | 3a | 3b | | 4a | 4b |
| | | rear terminal | front terminal | rear terminal | rear terminal | front terminal | rear terminal | front terminal | rear terminal |
| U-shaped separation kit for horizontal busbars 1600 A max. | external cable sleeves depth 475 mm | | 208 73 | | | 208 73 | | 208 73 | |
| | external cable sleeves depth 725 mm | | 208 74 | | | 208 74 | | 208 74 | |
| U-shaped separation kit for horizontal busbars 4000 A max. | external cable sleeves depth 725 mm | | 208 75 | | | 208 75 | | 208 75 | |
| | external cable sleeves depth 975 mm | | 208 86 | | | 208 86 | | 208 86 | |
| Side vertical divider for DPX 1600 | | | 205 96 | | | 205 96 | | 205 96 | |
| Side partition with and caps for functional units separation | height 200 mm | | | | | 205 97 | | 205 97 | |
| | height 300 mm | | | | | 205 98 | | 205 98 | |
| | height 400 mm | | | | | 205 99 | | 205 99 | |
| Vertical separation for rear busbars | depth 725 mm | | | 208 48 | | | 208 48 | | |
| | depth 975 mm | | | 208 49 | | | 208 49 | | |
| Separation for rear busbars | height 200 mm | | | 208 77 | | | 208 77 | | |
| | height 300 mm | | | 208 78 | | | 208 78 | | |
| | height 400 mm | | | 208 79 | | | 208 79 | | |
| Horizontal busbar separation | depth 725 mm | | | 208 93 | | | 208 93 | | |
| | depth 975 mm | | | 208 94 | | | 208 94 | | 208 94 |
| Rear vertical separation | | | | | | 208 69 | | 208 69 | |
| DPX compartment kit | height 200 mm | | | | | | | | 208 87 |
| | height 300 mm | | | | | | | | 208 88 |
| | height 400 mm | | | | | | | | 208 89 |
| Separation for cell without horizontal busbars | to close last DPX compartment | | | | | | | | 208 95 |
| Bottom busbar area closure | | | | | | | | | 208 96 |
| Rear separation divider for space compartment | | | | | | | | | 208 97 |
| DMX ³ , DMX ³ -I 2500 compartment kit | width 24 modules | | 208 18 | 208 18 | | 208 18 | 208 18 | 208 18 | 208 18 |
| DMX ³ , DMX ³ -I 4000, DMX ³ -L compartment kit | width 36 modules | | 208 19 | 208 19 | | 208 19 | 208 19 | 208 19 | 208 19 |

POWER GUIDE: A complete set of technical documentation



01 | Sustainable development



08 | Protection against external disturbances



02 | Power balance and choice of power supply solutions



09 | Operating functions




03 | Electrical energy supply



10 | Enclosures and assembly certification




04 | Sizing conductors and selecting protection devices



11 | Cabling components and control auxiliaries



05 | Breaking and protection devices



12 | Busbars and distribution



06 | Electrical hazards and protecting people



13 | Transport and distribution inside an installation



07 | Protection against lightning effects



Annexes
Glossary
Lexicon



**World Headquarters and
International Department**
87045 Limoges Cedex - France

☎ : + 33 (0) 5 55 06 87 87
Fax : + 33 (0) 5 55 06 74 55